


# **Water & Wastewater Repairs**

## **BTX Fiber Project (Citywide Fiber Project)**

### **Utility Damages and Project Coordination**

# 1644 Central Blvd.

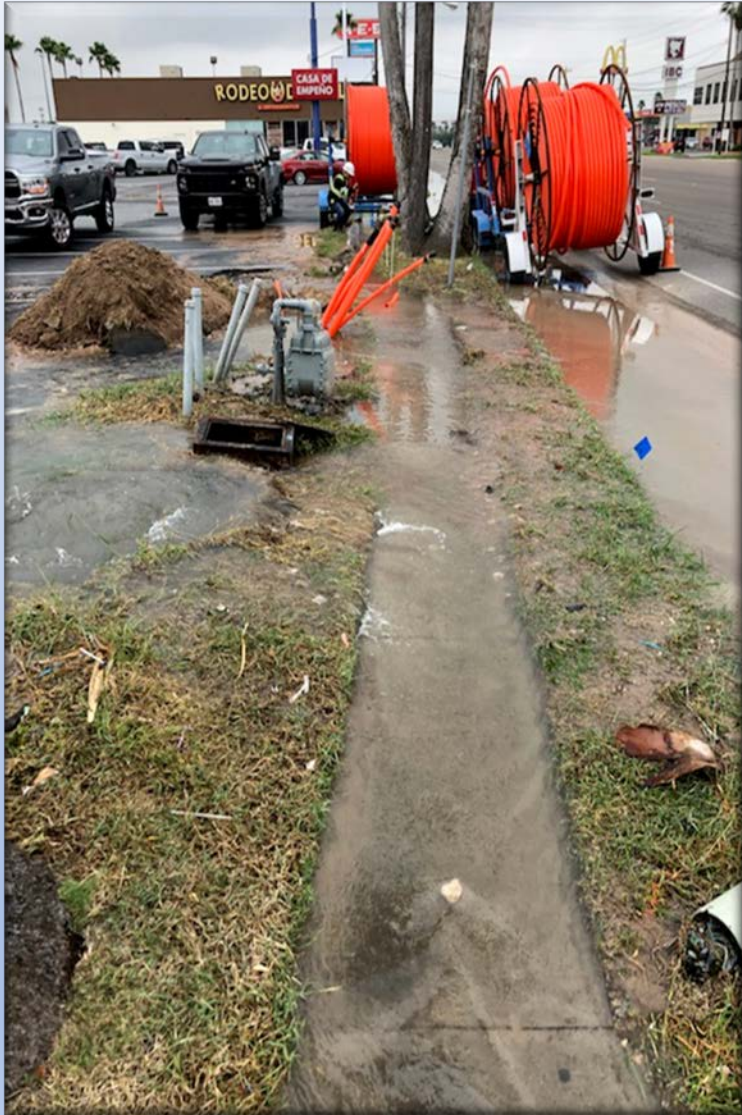

Date of incident	03/28/23
Service request #	705421
Work order #	212632
Contractor	G&T Utilities
Type of damage	Fireline
Line size	6 inch PVC
Customers affected	(1) Peter Piper Pizza
Interruption of service	8 hours
Approx. water loss	799,200 gallons
Estimate repair cost	\$6,073.29

Water Cost	\$1,710.49
Asphalt	\$720.00
Concrete	N/A



## 1740 Boca Chica Blvd.



Date of incident	04/01/23
Service request #	706159
Work order #	212762
Contractor	G&G Telecommunications
Type of damage	Water service line
Line size	2 inch copper
Customers affected	Business Plaza
Interruption of service	3 hours
Approx. water loss	15,000 gallons
Estimate repair cost	\$1,686.36

Water Cost	\$32.10
Asphalt	\$8,239.65
Concrete	N/A

Not in contractor's damage report.



## 805 West Price Rd.



Date of incident	04/03/23
Service request #	706342
Work order #	212829
Contractor	G&A Utilities
Type of damage	Water service line
Line size	2 inch PVC
Customers affected	Business Plaza
Interruption of service	4 hours
Approx. water loss	50,000 gallons
Estimate repair cost	Repaired by contractor

Water Cost	\$107.00
Asphalt	N/A
Concrete	N/A



## West 2<sup>nd</sup> St. and Elizabeth St.



Date of incident	04/06/23
Service request #	706876
Work order #	213149
Contractor	AQP Construction
Type of damage	Water main line
Line size	4 inch PVC
Customers affected	(20) Residential
Interruption of service	4 hours
Approx. water loss	500,000 gallons
Estimate repair cost	\$1,711.67

Water Cost	\$1,070.00
Asphalt	N/A
Concrete	N/A



## 1165 Wildrose Ln. and Barnard Rd.



Date of incident	04/20/23
Service request #	709232
Work order #	214242
Contractor	RGV Tele-communications
Type of damage	Water service line
Line size	2 inch PVC
Customers affected	(100) Palacio Real Apartments
Interruption of service	5 hours
Approx. water loss	100,000 gallons
Estimate repair cost	\$3,818.58

Water Cost	\$214.00
Asphalt	N/A
Concrete	N/A



## Old Alice Rd. and Los Ebanos Blvd.



Date of incident	04/24/23
Service request #	711925
Work order #	214384
Contractor	G&A Utilities
Type of damage	Water main line
Line size	12 inch PVC
Customers affected	(30) Residential
Interruption of service	2 hours
Approx. water loss	1,000,000 gallons
Estimate repair cost	\$8,600.93

Water Cost	\$2,140.00
Asphalt	\$1,499.85
Concrete	N/A



## 1900 Expressway 77 North Frontage Rd.



Date of incident	04/28/23
Service request #	713130
Work order #	214624
Contractor	AQP Construction
Type of damage	Water main line
Line size	8 inch PVC
Customers affected	(1) The Boot Jack
Interruption of service	4 hours
Approx. water loss	500,000 gallons
Estimate repair cost	\$5,596.21

Water Cost	\$1,070.00
Asphalt	\$480.15
Concrete	N/A

Not in contractor's damage report.



## East Jackson St. and Palm Blvd.




Date of incident	05/03/23
Service request #	719248
Work order #	215185
Contractor	AQP Construction
Type of damage	Water main line
Line size	8 inch AC
Customers affected	(50) Apartments and Residential homes
Interruption of service	6 hours
Approx. water loss	300,000 gallons
Estimate repair cost	\$4,168.36

Water Cost	\$642.00
Asphalt	\$599.85
Concrete	N/A



## West Saint Charles St. and West 8<sup>th</sup> St.

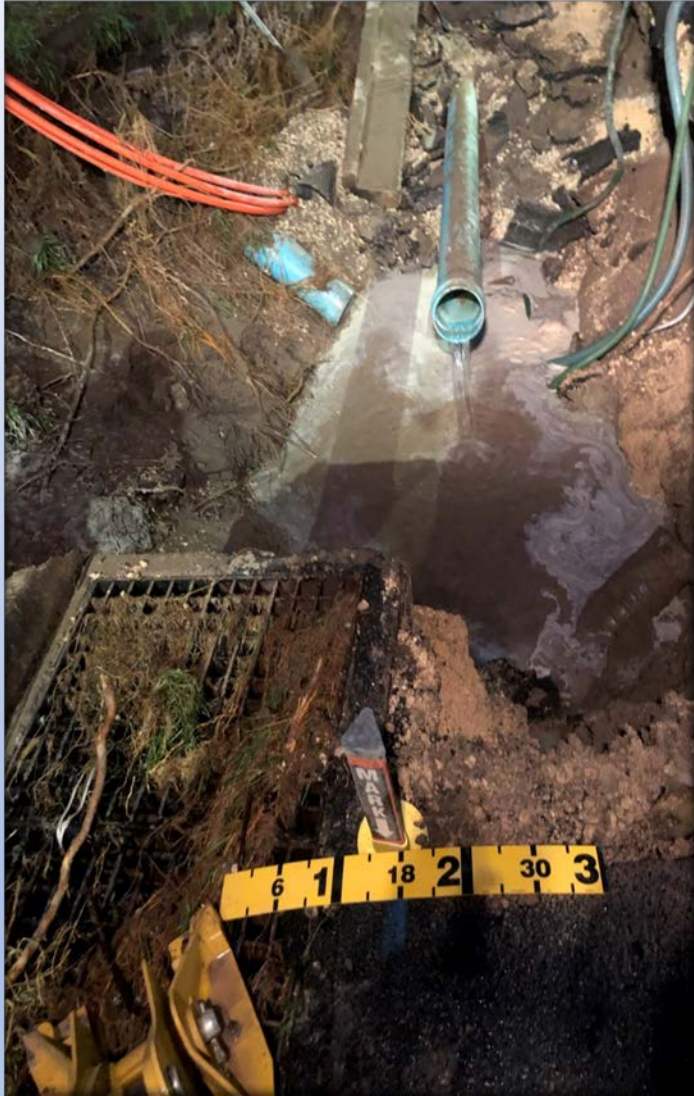

Date of incident	05/04/23
Service request #	719900
Work order #	215272
Contractor	G&A Utilities
Type of damage	Water main line
Line size	12 inch PVC
Customers affected	(30) Residential
Interruption of service	7 hours
Approx. water loss	2,000,000 gallons
Estimate repair cost	\$29,730.44

Water Cost	\$4,280.00
Asphalt	\$2,100.15
Concrete	\$105.00



## East 7<sup>th</sup> St. and East Ringgold St.



Date of incident	05/19/23
Service request #	725646
Work order #	215773
Contractor	RGV Boring Services
Type of damage	Fireline
Line size	6 inch PVC
Customers affected	(1) Brownsville Museum of Fine Art
Interruption of service	12 hours
Approx. water loss	1,000,000 gallons
Estimate repair cost	\$4,794.67

Water Cost	\$2,140.00
Asphalt	\$180.00
Concrete	N/A



# Morrison Rd. and Larkspur Dr.



Date of incident	05/31/23
Service request #	727249
Work order #	216592
Contractor	G&A Utilities
Type of damage	Wastewater force main line
Line size	24 inch PVC
Customers affected	None
Interruption of service	4 days – Road Closer
Estimate repair cost	\$74,970.21

Water Cost	N/A
Asphalt	\$6,300.00
Concrete	\$2,697.50



## 500 Ringgold St.



Date of incident	06/06/23
Service request #	730647
Work order #	216594
Contractor	Brownsville Underground Drilling
Type of damage	Water main line
Line size	8 inch PVC
Customers affected	(2) Dean Porter Park and The Children's Museum
Interruption of service	9 hours
Approx. water loss	450,000 gallons
Estimate repair cost	\$5,180.92

Water Cost	\$963.00
Asphalt	N/A
Concrete	\$2,158.00



## East 15<sup>th</sup> St. and East Jefferson St.



Date of incident	06/09/23
Service request #	731278
Work order #	
Contractor	AC Contracting
Type of damage	Water main line
Line size	6 inch PVC
Customers affected	None – Only fire hydrant
Interruption of service	None
Approx. water loss	898,080 gallons
Estimate repair cost	Repair has not been finalized

Water Cost	\$1,921.89
Asphalt	N/A
Concrete	N/A



## Total cost

<b>Repair Cost</b>	<b>\$146,331.64</b>
<b>Water Cost</b>	<b>\$16,290.48</b>
<b>Asphalt</b>	<b>\$20,119.65</b>
<b>Concrete</b>	<b>\$4,960.50</b>
<b>Grand Total Cost:</b>	<b>\$187,702.27</b>