

BROWNSVILLE PUBLIC UTILITIES BOARD ELECTRICAL ENGINEERING DEPARTMENT

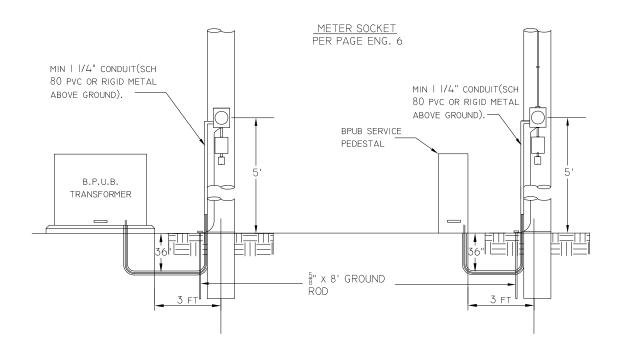

ELEVATION VIEW DASHED LINES ARE APPROXIMATE LOCATIONS OF UNDERGROUND ENERGIZED CABLES.

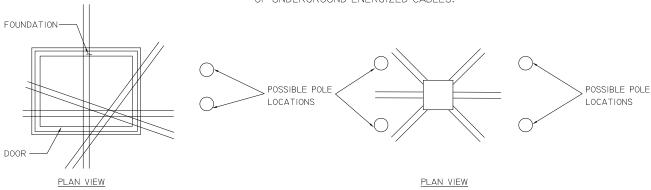

NOTE:

- I. ALL COMPONENTS SHALL BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND LOCAL CODES.
- 2. CUSTOMER TO PROVIDE 36" OF SERVICE ENTRANCE CONDUCTOR BEYOND CONDUIT.
- 3. RECEPTACLES SHALL HAVE APPROVED GROUND FAULT CIRCUIT PROTECTION, AS REUIRED BY LOCAL CODES.



STANDARD DISTRIBUTION CONSTRUCTION

TEMPORARY SERVICE FROM UNDERGROUND RESIDENTIAL DISTRIBUTION

		•
]	D-	1

	DEVELOPED BY:	STANDARDS COMMITTEE	
	APPROVED:	SEP 2020	
	DRAWING NUMBER	STD-D-106	

