


1" CHAMFER-ALL CORNERS FRONT OF TRANS. PLAN



CONCRETE PAD FOR 25KVA TO 100KVA Ø TRANSFORMER

- NOTE:
1. USE 3000 P.S.I. CONCRETE.
 2. SLAB THICKNESS TO BE 12".
 3. ALL REINFORCING STEEL TO BE 3" BELOW TOP OF PAD.

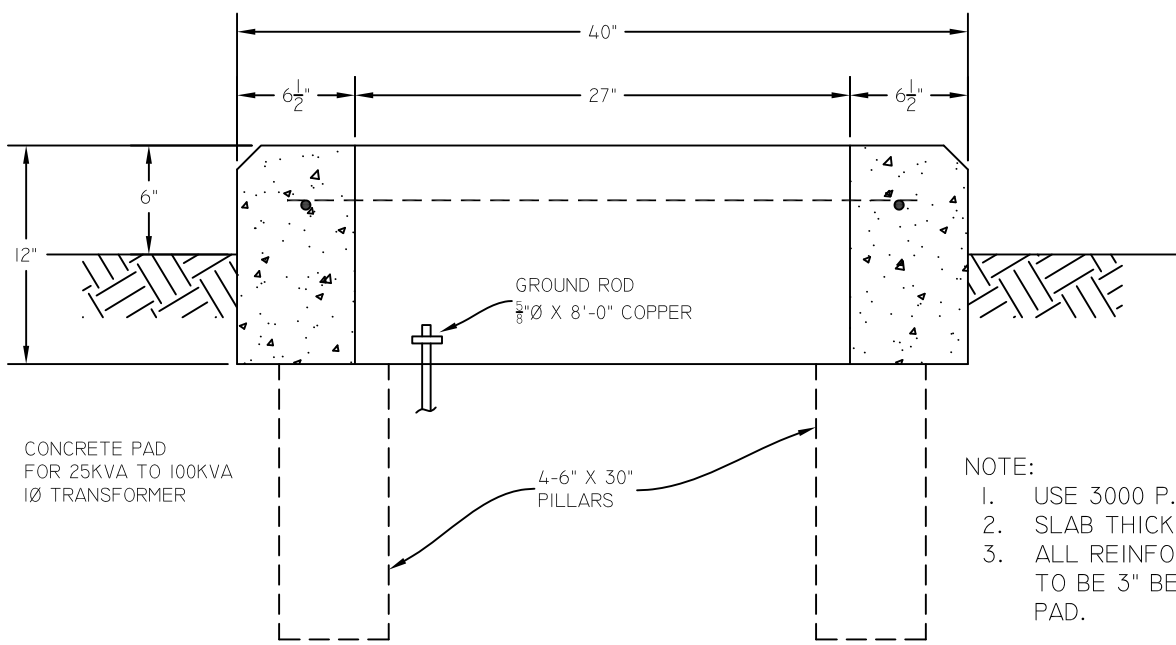

TYPICAL STEEL REINFORCED CONCRETE PAD FOR SINGLE-PHASE PAD-MOUNTED TRANSFORMER

DEVELOPED BY:
APPROVED:
DRAWING NUMBER

STANDARDS COMMITTEE
SEP 2020
UD-14

