



Date: June 5, 2024
To: All Vendors
Subject: Addendum #1

REFERENCE: B047-24 Leak Detection Services

This Addendum forms part of the contract and clarifies, corrects or modifies original bid document.

Question 1: Is it possible to obtain a pipe inventory for sizes and pipe materials?

Answer 1: Pipe sizes range from ¾" to 36". Materials in the water system are PVC, AC, CSC and DI. Attached is an overall view of waterline lengths by quadrants and tiles.

Question 2: Where the estimated quantity is showing 468, is this the miles we are to survey?

Answer 2: Yes, the total amount of pipes in BPUB's system is 486 miles, which includes service lines.

Question 3: Does BPUB want crews for a day and night shift?

Answer 3: Yes, day and night crews will be needed. Night work may be needed in areas of heavy traffic for better readings.

Question 4: Is the vendor supposed to train BPUB personnel on the leak detection process or just review the report with them?

Answer 4: The training should be field training session with BPUB personnel.

The signature of the company agent, for the acknowledgement of this addendum, shall be required. **Complete information below and return via e-mail to: dsolitaire@brownsville-pub.com.**

I hereby acknowledge receipt of this addendum.

Company: _____

Agent Name: _____

Agent Signature: _____

Address: _____

City: _____ **State:** _____ **Zip:** _____


Phone Number: _____ **E-mail address:** _____

If you have any further questions about the Bid, call 956-983-6366.


BY: ***Diane Solitaire***
Purchasing

BPUB PVC Waterline Lengths by Quadrants and Tiles

Quadrant	Miles
Northwest	209
Northeast	139
Southwest	56
Southeast	64
Grand Total	468

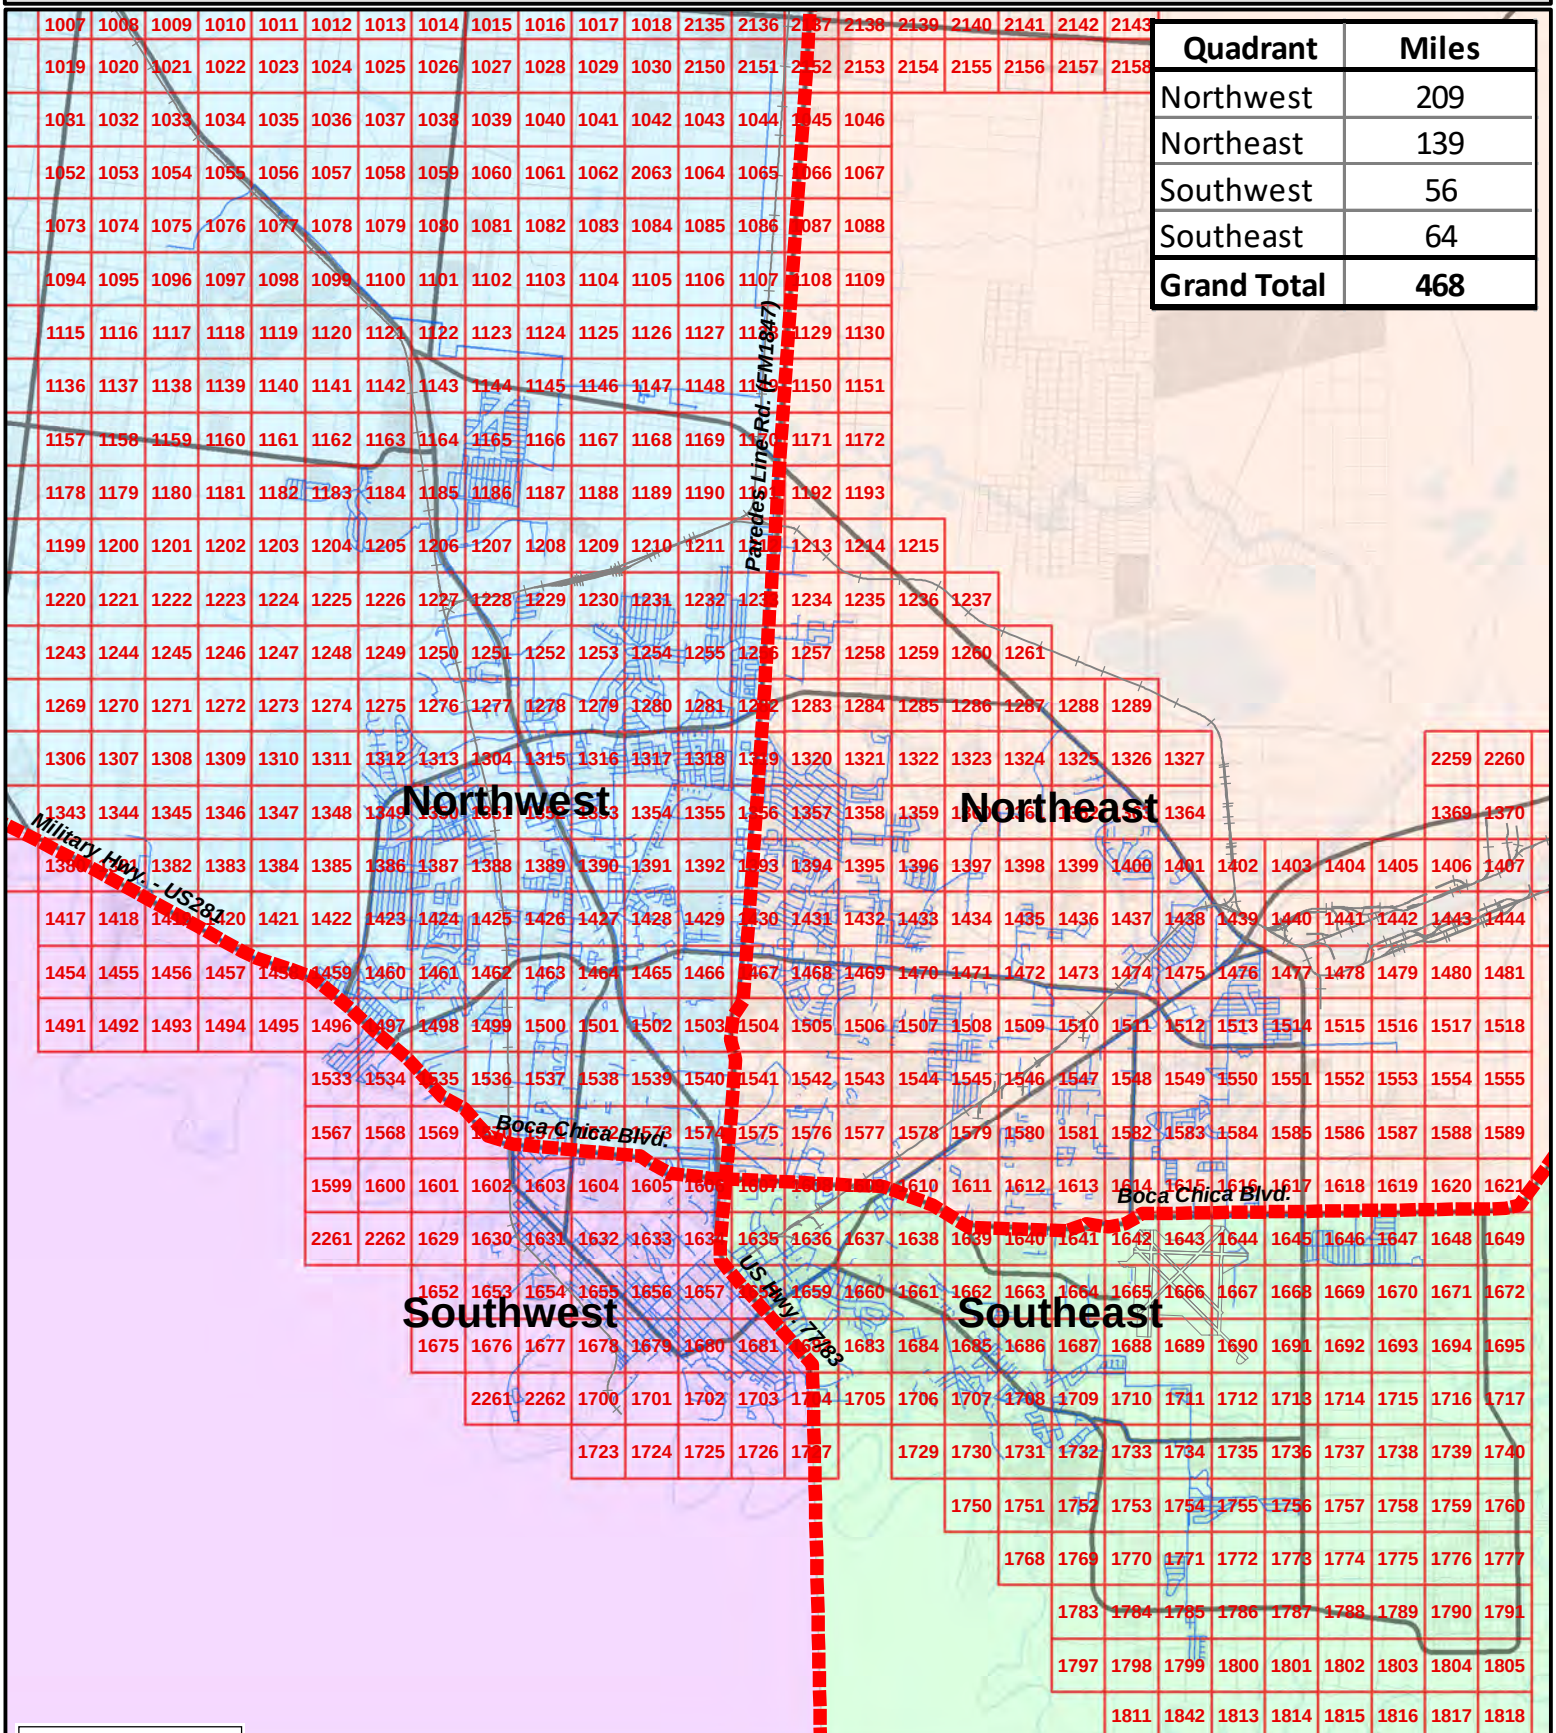

Legend	
---	Quadrant Borders
	Northeast
	Northwest
	Southeast
	Southwest
---	PVC Waterlines



Date: 6/10/2021 Drawn by: LGM

DISCLAIMER - PUBLIC UTILITIES OF BROWNSVILLE

This map was created using data obtained from various sources, and created exclusively for the internal use of the Public Utilities Board of Brownsville. Portions of the information may be incorrect or not current. Any person or entity who relies on any information obtained from these maps does so at their own risk. Neither the Public Utilities Board of Brownsville, Texas, nor any agency, Officer, or employee of the Public Utilities Board of Brownsville, Texas warrants the accuracy, reliability, or timeliness of such information. THIS MAP IS PROVIDED "AS-IS" WITHOUT WARRANTY OF ANY KIND, EITHER EXPRESSED OR IMPLIED, INCLUDING, BUT NOT LIMITED TO THE IMPLIED WARRANTIES OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, OR NON-INFRINGEMENT. THE PUBLIC UTILITIES BOARD OF BROWNSVILLE SHALL NOT BE LIABLE FOR ANY DIRECT, INDIRECT, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES RELATED TO THE USE OF THIS MAP, EVEN IF THE PUBLIC UTILITIES BOARD OF BROWNSVILLE IS ADVISED OF SUCH DAMAGE.

THIS MAP IS FOR REFERENCE ONLY