




## City of Brownsville Non-Domestic Wastewater Pretreatment Ordinance 2020-795-G

### Section 102-383

#### Fats, Oil and Greases (FOG)

#### Abatement Determination Flow Chart

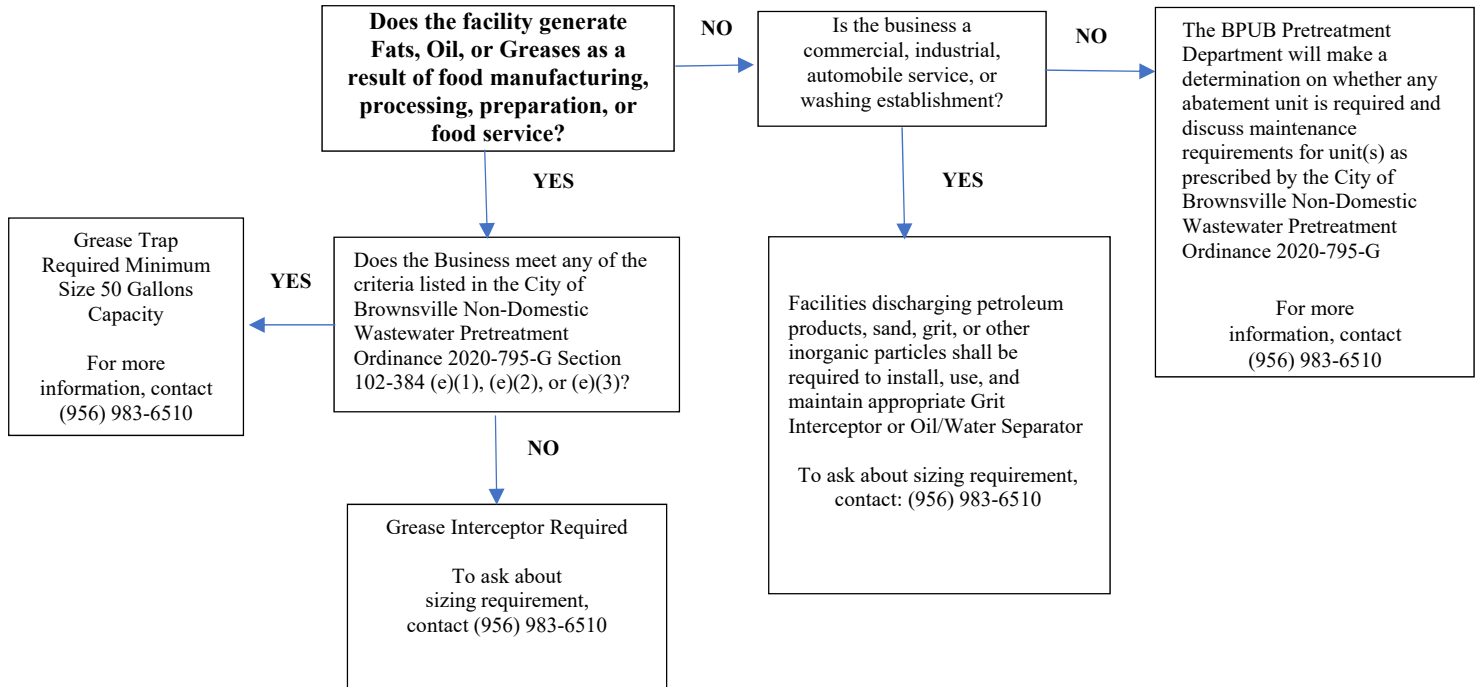

#### Program Exemptions:

1. Snow Cone/Raspa stands that serve ONLY ice-based desserts;
2. Facilities that serve only precooked foods or beverages and no washing is performed at the facility;
3. Home care centers with a maximum capacity of 12 customers (not including attendant staff);
4. Day care centers that provide catered food brought in from a separate food preparation facility; or
5. Facilities that are not connected to the Publicly Owned Treatment Works system of the City of Brownsville.

#### Abatement Unit Cleaning Frequencies:

Grease Trap – Minimum of every 30 calendar days or more often when necessary (102-385 (c)(4)).

Grease Interceptor, Grit Interceptor and Oil/Water Separator – Minimum of every 90 calendar days or more often when necessary (102-385 (c)(1)).

*This Brownsville Public Utilities Board Pretreatment Requirements for New Buildings Document was last updated: March 7, 2025*

#### **Brownsville Public Utilities Board**

1425 Robinhood Drive  
P.O. Box 3270  
Brownsville, TX 78521

[www.brownsville-pub.com](http://www.brownsville-pub.com)

(956) 983-6510  
Fax: (956) 574-6114