



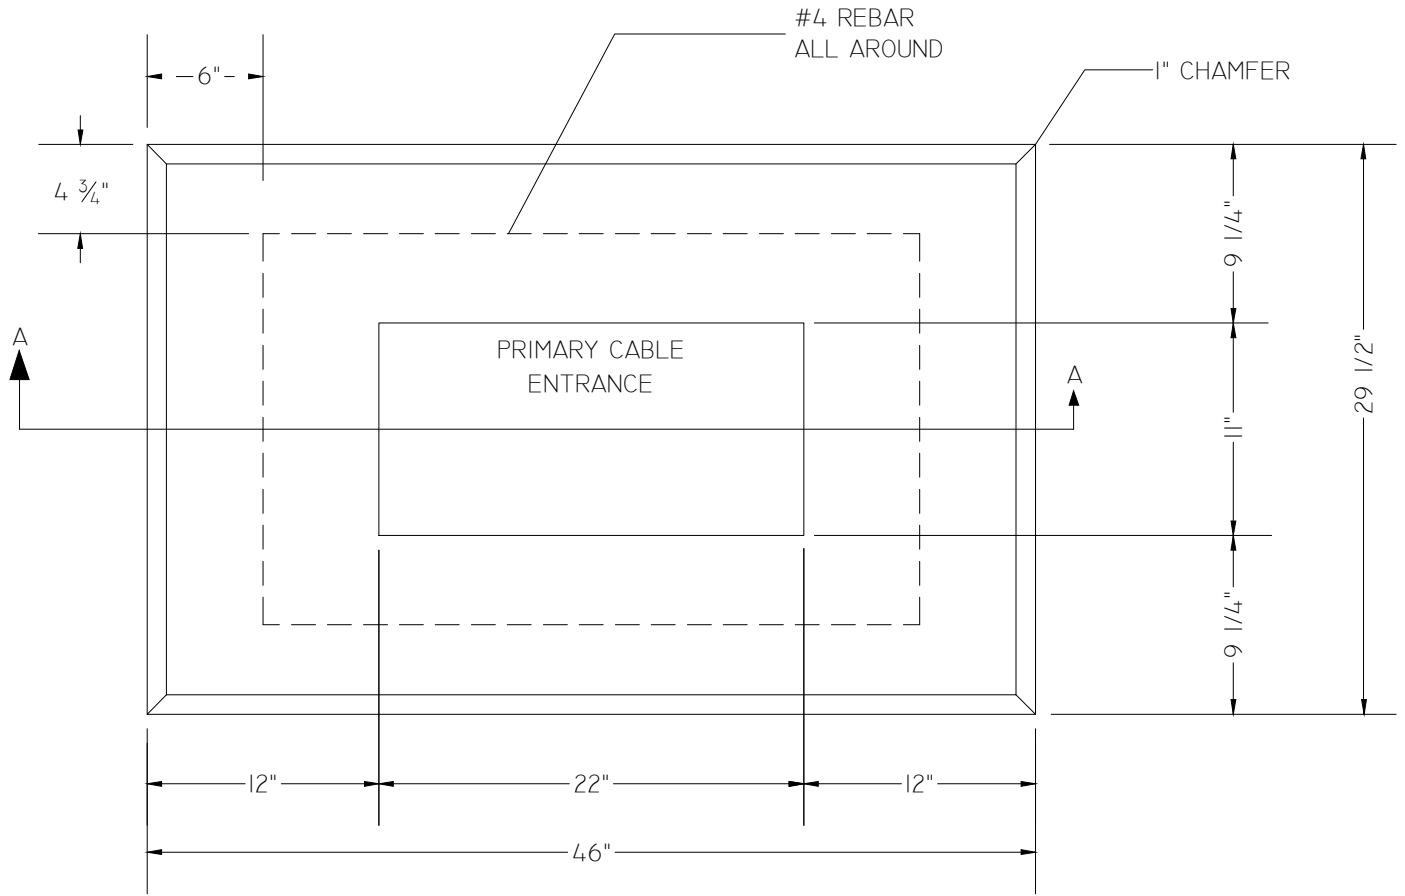

PLAN VIEW

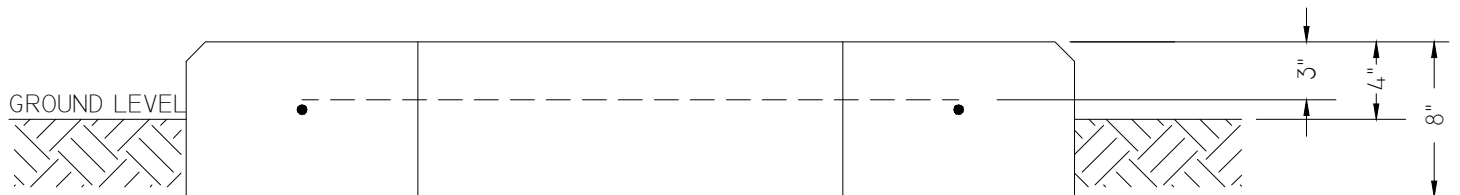

SECTION A-A

NOTES:

1. USE 3000 P.S.I. CONCRETE.
2. SLAB THICKNESS TO BE 8" MINIMUM.
3. ALL REINFORCING STEEL TO BE 3" BELOW TOP OF PAD.
4. COMPACT SOIL 95% BEFORE INSTALLING CONCRETE PAD.
5. ALL MATERIALS PROVIDED AND INSTALLED BY THE COSTUMER.
6. ANCHOR BOLTS INSTALLED BY BPUB.
7. MUST MEET ALL REQUIREMENTS OF BPUB STANDARD DRAWING ENG-8.



SINGLE-PHASE
SECTIONALIZER CONCRETE PAD

DEVELOPED BY:

STANDARDS
COMMITTEE

APPROVED:

SEP 2020

DRAWING
NUMBER

UD-18B

