


**BROWNSVILLE PUBLIC UTILITIES BOARD
ELECTRICAL ENGINEERING DEPARTMENT**



- NOTE:
1. RECOMMENDED METHOD FOR LOW ROOF RANCH TYPE HOUSE WHERE CABLES ARE NOT EXISTING OR HOUSE IS NOT HIGH ENOUGH FOR ATTACHMENT OF SERVICE IN USUAL MANNER.
 2. POINT OF ATTACHMENT FOR SERVICE MUST BE OF SUFFICIENT HEIGHT TO MAINTAIN, FOR THE SERVICE, A 12' MINIMUM CLEARANCE, 18' MINIMUM TO COMMERCIAL DRIVEWAY AND 22' MINIMUM TO STREET.

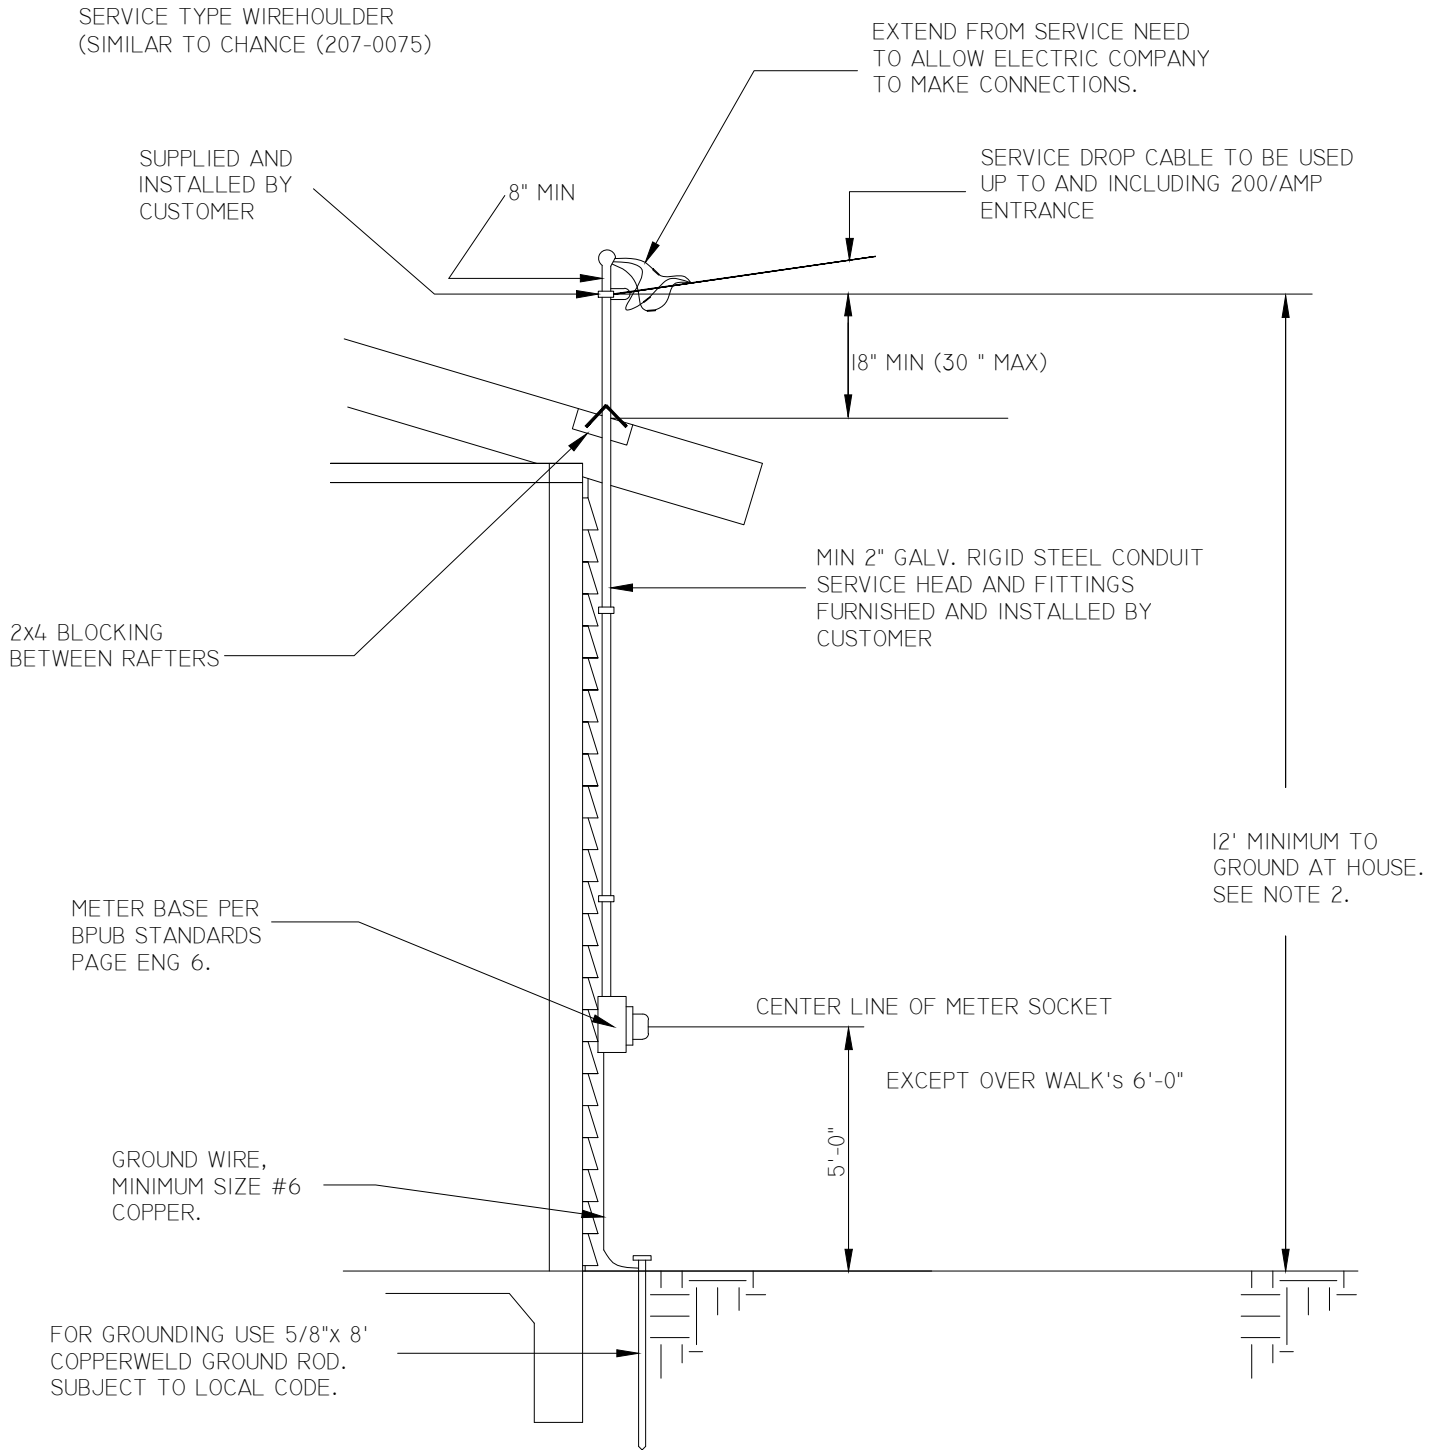

**BROWNSVILLE
PUBLIC UTILITIES BOARD**

STANDARD DISTRIBUTION CONSTRUCTION
**SERVICE ENTRANCE FOR LOW
ROOF HOUSING**
F-1

DEVELOPED BY:

STANDARDS
COMMITTEE

APPROVED:

SEP 2020

DRAWING
NUMBER

STD D-101

