
BROWNSVILLE PUBLIC UTILITIES BOARD ELECTRICAL ENGINEERING DEPARTMENT



- I. SPECIFICATIONS SHOWN ARE MINIMUM ONLY.
- 2. PUB SHALL BE CONSULTED ON EACH INSTALLATION REQUIRING CONDUCTOR LARGER THAN 300 MCM.
- 3. METER SOCKET AND METERING CONDUIT WILL BE FIRMLY SECURED TO BUILDING.
- 4. Provisions for anchoring service attachment to building to be provided by customer.
- 5. SERVICE ENTRANCE CAP MUST BE ABOVE POINT OF SERVICE ATTACHEMENTS AND HIGH ENOUGH TO MAINTAIN SERVICE WIRES A GROUND CLEARANCE OF 12' MINIMUM, 18' MINIMUM TO COMMERCIAL DRIVEWAYS OR PARKING LOTS, AND 22' MINIMUM TO STREET.
- 6. PARALLEL PHASE CONDUCTORS SHALL BE MARKED BY THEIR RESPECTIVE PHASE.

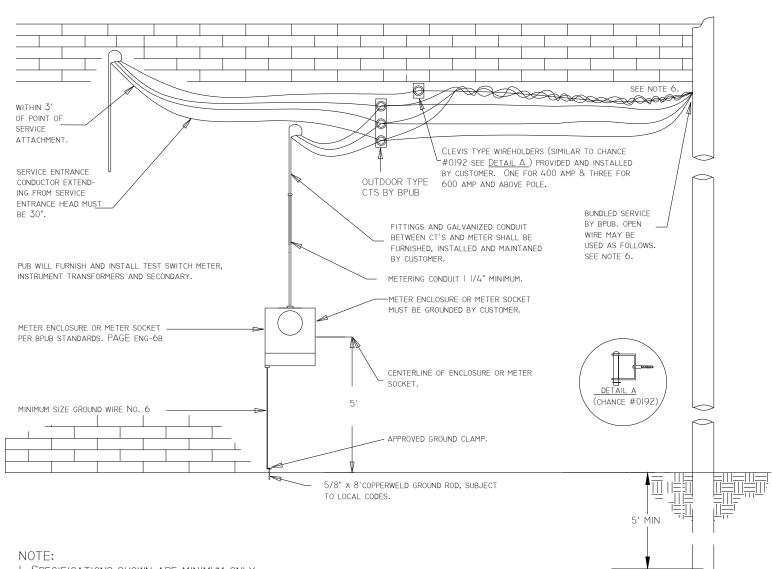

STANDARD DISTRIBUTION CONSTRUCTION	
TYPICAL CURRENT TRANFORMER INSTALLATION	Ĺ
G-1	

DEVELOPED BY:	STANDARDS COMMITTEE	
APPROVED:	SEP 2020	
DRAWING NUMBER	STD D-105	

