




NOTES:

1. ALL MATERIAL TO BE SUPPLIED AND INSTALLED BY THE CUSTOMER. CUSTOMER WILL TRENCH ONE FOOT (1') FROM THE EDGE OF TRANSFORMER PAD OR PEDESTAL. BPUB WILL MAKE FINAL TRENCHING AND CONNECTIONS. CUSTOMERS WIRING FROM LINE TERMINALS OF METER SOCKET TO CONNECTIONS AT SERVICE PEDESTAL OR PAD TRANSFORMER. MUST BE PROTECTED BY SCHEDULE 80 OR RIGID IN ALL AREAS EXPOSED ABOVE GROUND.
2. CUSTOMER SHALL NOT ALLOW POLE TO BE MOVED OR TAMPERED WITH AS LONG AS COMPANY'S SERVICE WIRES ARE ATTACHED.

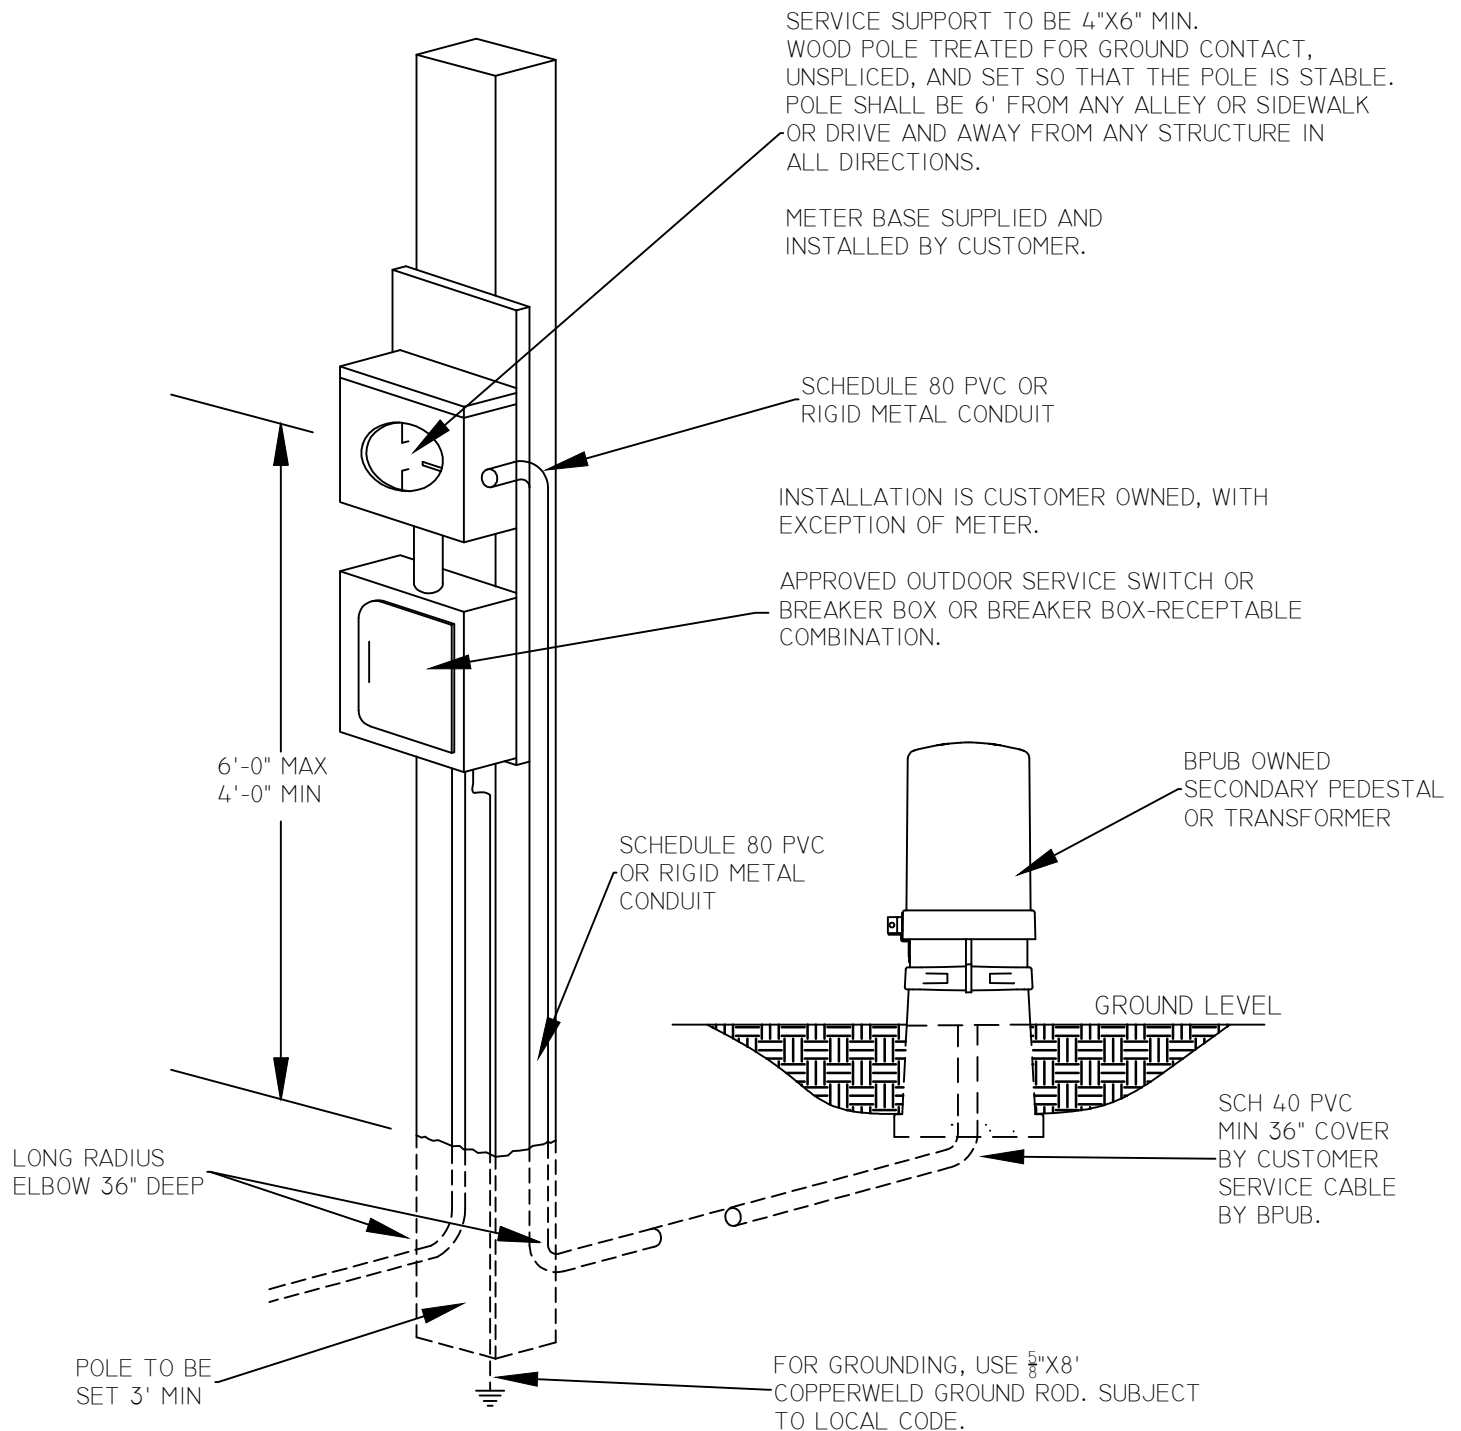

**CUSTOMER'S PERMANENT
METER POLE INSTALLATION
FOR UNDERGROUND SERVICE
INCLUDING RVS & MOBILE HOMES**

DEVELOPED BY:

STANDARDS
COMMITTEE

APPROVED:

SEP 2020

DRAWING
NUMBER

UD-5C

