




NOTES:

1. ALL MATERIAL TO BE SUPPLIED AND INSTALLED BY THE CUSTOMER, MUST BE PROTECTED BY SCHEDULE 80 OR RIGID IN ALL AREAS EXPOSED ABOVE GROUND.
2. CUSTOMER SHALL NOT ALLOW POLE TO BE MOVED OR TAMPERED WITH AS LONG AS COMPANY'S SERVICE WIRES ARE ATTACHED.
3. OVERHEAD SERVICE DROP CLEARANCE FROM GROUND SHALL BE 20' WHEN SUBJECT TO VEHICULAR TRAFFIC IN ANY DIRECTION.

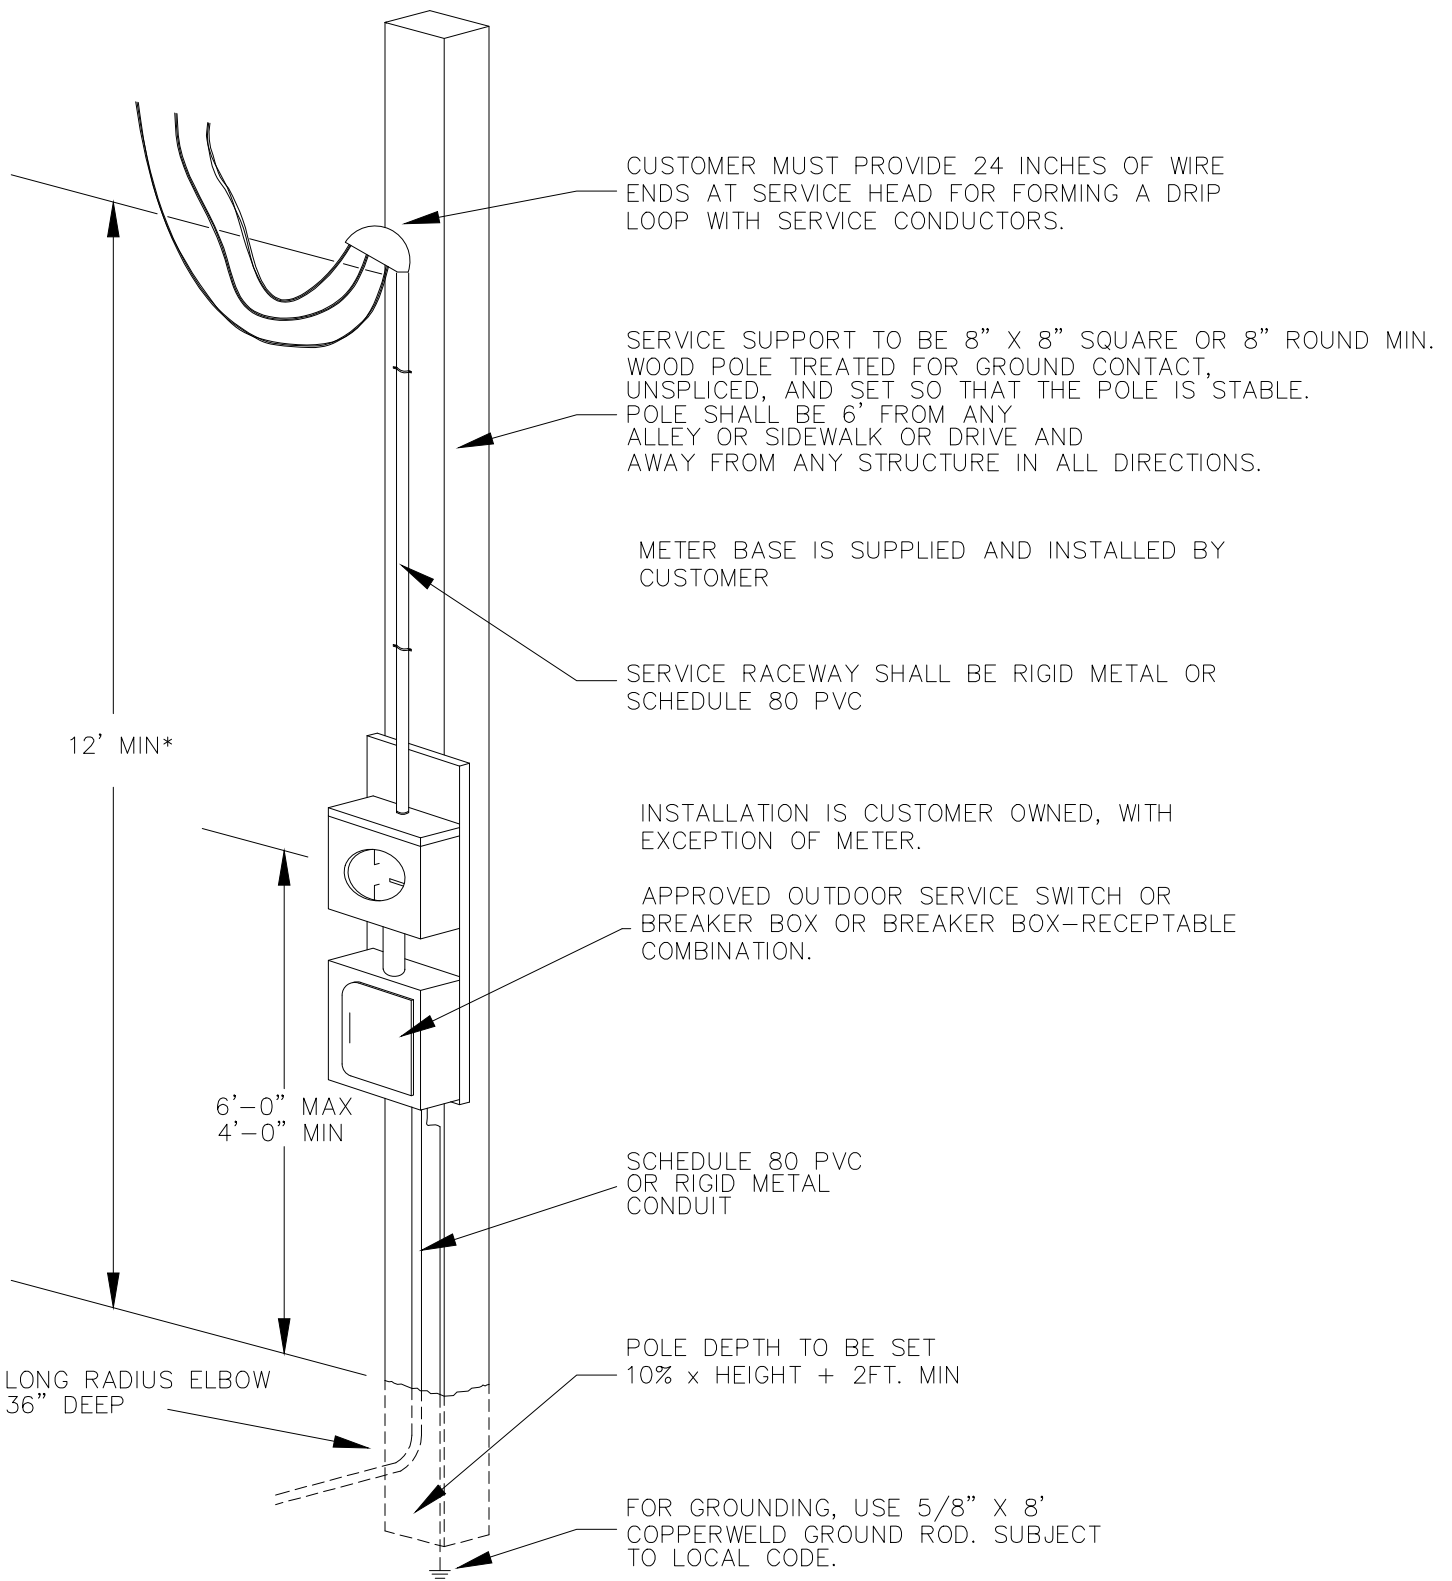

**CUSTOMER'S PERMANENT
METER POLE INSTALLATION
FOR OVERHEAD SERVICE**

DEVELOPED BY:

STANDARDS
COMMITTEE

APPROVED:

SEP 2020

DRAWING
NUMBER

UD-5D

