



LEGAL NOTICE

AND

INVITATION TO BID

B #035-26

The Brownsville Public Utilities Board will accept electronic or sealed bids for the Supply of Polemount and Padmount Transformers, **until 5:00 PM, April 15, 2026** in the Brownsville PUB Purchasing Office, 1155 FM 511, Olmito, Texas. **Electronic or sealed bids received after this time will not be considered.**

Bids will be publicly opened and read aloud on April 16, 2026 at 10:00 AM. Bidders can request a copy of the bid tabulation by emailing hlopez@brownsville-pub.com. Vendors can call in at 10:00 AM, April 16, 2026 to (956) 214-6020 to listen to the bid opening.

Brownsville Public Utilities Board utilizes the Texas Purchasing Group to post Request for Proposal (RFP) and bid opportunities. Registration is available at <https://www.bidnetdirect.com/texas/brownsville-pub>, if you haven't already registered.

Detailed specifications may also be obtained at Brownsville Public Utilities Board website at https://www.brownsville-pub.com/rfp_status/open/.

Please mark on the **outside of the envelope and on any carrier's envelopes: "SEALED BIDS FOR SUPPLY OF POLEMOUNT AND PADMOUNT TRANSFORMERS (B035-26), April 15, 2026 5:00 PM"**, and send to the attention of Diane Solitaire, Purchasing Department, 1155 FM 511, Olmito, TX 78575.

The Brownsville Public Utilities Board will not be responsible in the event that the U.S. Postal Service or any other courier system fails to deliver the sealed bids to the Brownsville Public Utilities Board, Purchasing Office by the given deadline above. **Bid will be accepted via electronic transmission through Bidnet, only.**

The Brownsville PUB reserves the right to reject any or all bids and to waive irregularities contained therein and to accept any bid deemed most advantageous to the Brownsville PUB.

BY:

Diane Solitaire

Purchasing

(956) 983-6366 - Phone

Please submit this page upon receipt.

ACKNOWLEDGEMENT FORM

B#035-26 Supply of Polemount and Padmount Transformers

For any clarifications, please contact Hugo E. Lopez at the Brownsville Public Utilities Board, Purchasing Department via e-mail: hlopez@brownsville-pub.com

Please e-mail this page upon receipt of legal notice. If you only received the legal notice and you want the bid package mailed, please provide a method of shipment with account number.

Check one:

Yes, I will be able to send a bid; obtained bid package from website.

Yes, I will be able to send a bid; please email the bid package.

Email: _____

No, I will not be able to send a bid for the following reason:

If you are unable to send your bid, kindly indicate your reason for “No bid” above and return this form **via e-mail to:** hlopez@brownsville-pub.com or dsolitaire@brownsville-pub.com. This will ensure you remain active on our vendor list.

Date _____

Company: _____

Name: _____

Address: _____

City: _____ State: _____ Zip Code: _____

Phone: _____ E-mail: _____

Email: _____

IF SPECIFICATIONS ARE DOWNLOADED FROM WEBSITE PLEASE EMAIL THIS PAGE TO EMAIL LISTED ABOVE

Special Instructions

Contract Information

- **Interpretation**

Questions concerning terms, conditions, and technical specifications should be directed to:

Hugo E. Lopez,
Purchasing Administrator
(956) 983-6375

or

Diane Solitaire,
Purchasing & Materials Manager
(956) 983-6366

- **Tentative Time Line**

1. March 30, 2026 through April 15, 2026 - Vendors work on bid.
2. April 15, 2026 at 5:00 PM CST - **Vendor must submit 1 set of bid documents sealed in an envelope to:**

Diane Solitaire, Purchasing
1155 FM 511
Olmito, TX 78575

Bid 035-26, Supply of Polemount and Padmount Transformers
Due on April 15, 2026 at 5:00 PM CST

*The above noted information must be included on bid envelope and on any carrier's envelope/package. **The Brownsville Public Utilities Board will not be held responsible for missing, lost or late mail or late electronic transmission.** Brownsville Public Utilities Board will accept electronic transmission of sealed bids via **Bidnet, only.***

3. April 10, 2026 – Last day to submit questions
4. April 16, 2026 – Open bids at 10:00 AM
5. April 17, 2026 – April 22, 2026 - Evaluate bids
6. April 23, 2026 - Provide Final Recommendations
7. May 11, 2026 - Send to Utilities Board for approval
8. Term of contract will commence May 2026

- **Or Equal**

Brand name or manufacturer's reference used in this request is descriptive – not restrictive – it is intended to indicate type and quality desired. Brands of like nature and quality will be considered. If bidding on other than referenced specifications please provide complete descriptive information of said article.

- **Pricing**

Bid unit price on quantity specified, extend and show total. In case of errors in extension, unit prices shall govern. **Price shall remain firm until an award is made and after original date of Purchase Order, unless otherwise stipulated.**

All fields (UNIT PRICE, TOTAL PRICE, & EST DELIVERY IN DAY) in the specifications pages must be filled. The data must be complete to identify the bidding brand.

Failure to submit any of the above information with the sealed bid will disqualify bid.

- **Vendor Representative**

The successful vendor agrees to send a personal representative with binding authority for the company to the Brownsville Public Utilities Board upon request to make adjustments and/or assist with coordination of all transactions as needed.

- **Quality of Products**

All items must be new, in first class condition, including containers suitable for shipment and storage. No substitutions in standard grades or lesser quality will be accepted.

- **Determining Factors for Award**

1. Total Evaluated Cost (TEC=Bid Price+NLLC+LLC)
2. Delivery/Lead Time
3. Stock Availability
4. Reputation of the Bidder
5. Reputation of brand names offered
6. BPUB financial and legal responsibility evaluations of any identified teaming arrangements involving significant joint ventures, subcontractors and suppliers

- **Contract with Vendor/Entity Indebted to BPUB**

It is a policy of the BPUB to refuse to enter into a contract or other transaction with an individual, sole proprietorship, joint venture, Limited Liability Company or other entity indebted to BPUB.

- **Vendor ACH (Direct Deposit) Services**

BPUB has implemented a payment service for vendors by depositing the payment directly to the vendor's bank account. Successful vendor(s) will be required to receive payments directly through Automated Clearing House (ACH) in lieu of a paper check. **The awarded vendor must agree to receive payments via ACH (Direct Deposit).**

- **Tax Identification Number (TIN)**

In accordance with IRS Publication 1220, aW9 form, or a W8 form in cases of a foreign vendor, will be required of all vendors doing business with the Brownsville PUB. If a W9 or W8 form is not made available to Brownsville PUB, the first payment will be subject to income tax withholding at a rate of 28% or 30% depending on the U.S. status and the source of income as per IRS Publication 1220. **The W9 or W8 form must be included with bid response.** Attached are sample forms.

- **Taxes**

The Brownsville Public Utilities Board is exempt from Federal Excise Tax, State Tax and local Taxes. Do not include tax in the bid. If it is determined that tax was included in the bid it will not be included in the tabulation or any awards. Tax exemption certificates will be furnished upon request.

- **Signing of Bid**

Failure to sign bid will disqualify it. Person signing bid should show title or authority to bind their firm to a contract.

- **EEOC Guidelines**

During the performance of this contract, the contractor agrees not to discriminate against any employee or applicant for employment because of race, national origin, age, religion, gender, marital or veteran status, or physically challenging condition.

- **As Needed Basis (Reserved)**

Quantities are to be released on an “as needed” basis and be billed as such. However, successful vendor must keep in stock one (1) release, if requested in bid, for immediate shipment to the BPUB. Brownsville PUB will not accept the full quantity at one time as specified on Cost Sheet.

- **Contract and Purchase Order**

The transformers shall be delivered FOB Brownsville Public Utilities Board, 1155 FM511, Olmito, TX 78575, via flat-bed open trailer. Transformers shipped **in an enclosed trailer will be rejected upon delivery.** A contract for the transformers will be placed into effect by means of a purchase order issued by the Brownsville Public Utilities Board after tabulation and final approval by the BPUB Board of Directors.

- **Brownsville Public Utilities Board Rights**

1. If only one or no bid is received by "submission date", the BPUB has the right to reject, re-bid, accept and/or extend the bid by up to an additional two (2) weeks from original submission date.

2. The right to reject any/or all bids and to make award as they may appear to be advantageous to the Brownsville Public Utilities Board.
3. The right to hold bid for 90 days from submission date without action, and to waive all formalities in bid.
4. The right to extend the total bid beyond the original 90 days period prior to an award, if agreed upon in writing by all parties (BPUB and vendor/contractor) and if bidder/vendor holds original bid prices firm.
5. The right to terminate for cause or convenience all or any part of the unfinished portion of the Project resulting from this solicitation within Thirty (30) calendar days written notice; for cause: upon default by the vendor/contractor, for delay or non-performance by the vendor/contractor; or if it is deemed in the best interest of the BPUB for BPUB's convenience.
6. The right to increase or decrease quantities. In bid, stipulate whether an increase or decrease in quantities will affect bid price
7. The Brownsville PUB has the right to refuse to enter into a contract or other transaction with any individual or entity indebted to the municipality as per Local Government Code 252.0436.

- **Corrections**

Any interpretation, correction, or change to the invitation to bid will be made by ADDENDUM. Changes or corrections will be issued by the Brownsville PUB Purchasing Department. **Addenda will be emailed to all who have returned the Bid Acknowledgment form.** Addenda will be issued as expeditiously as possible. It is the responsibility of the vendors to determine whether all addenda have been received. It will be the responsibility of all respondents to contact the Brownsville PUB prior to submitting a response to the invitation to bid to ascertain if any addenda have been issued, and to obtain any all addenda, execute them, and return addenda with the response to the invitation to bid. Addenda may be posted on the Brownsville PUB's website.

REFERENCE CHECKS

The BPUB will contact prospective firm's references by email or telephone. **Complete the attached "Previous Customer Reference Worksheet" for each reference provided.**

**COST SHEET
B035-26**

Note: SINGLE PHASE with **304 stainless steel enclosure (tank and lid) Polemount Transformers**. All specifications and dimensions will remain the same.

ITEM #	QTY	DESCRIPTION	UNIT PRICE	EXTENDED TOTAL	DELIVERY IN DAYS (ARO)
			304 STAINLESS STEEL TRANSFORMERS		
POLEMOUNT, SINGLE PHASE TRANSFORMER					
1	6 each	(E1411-01) 15 KVA 7200 120/240 POLEMOUNT (tap changer +/-2.5%) with Internal Fault Detector NL: LL: TL:			

Note: The transformers shall be delivered FOB Brownsville Public Utilities Board, 1155 FM 511, Olmito, Texas 78575 **via open/flatbed trailer. Transformers shipped in an enclosed trailer will be rejected upon delivery.**

Note: **SINGLE PHASE** with **304 stainless steel enclosure (tank, lid, cabinet) Padmount Transformers**. All specifications and dimensions will remain the same.

ITEM #	QTY	DESCRIPTION	UNIT PRICE 304 STAINLESS STEEL TRANSFORMERS	EXTENDED TOTAL	DELIVERY IN DAYS (ARO)
PADMOUNT, SINGLE PHASE TRANSFORMER					
5	5 each	(E1502-00) 37.5 KVA 7200 120/240 PADMOUNT (tap changer +/-2.5%) with Internal Fault Detector NL: LL: TL:			

Note: The transformers shall be delivered FOB Brownsville Public Utilities Board, 1155 FM 511, Olmito, Texas 78575 **via open/flatbed trailer. Transformers shipped in an enclosed trailer will be rejected upon delivery.**

Note: **THREE PHASE** with **304 stainless steel enclosure (tank, lid, cabinet) Padmount Transformers.** All specifications and dimensions will remain the same.

ITEM #	QTY	DESCRIPTION	UNIT PRICE 304 STAINLESS STEEL TRANSFORMERS	EXTENDED TOTAL	DELIVERY IN DAYS (ARO)
PADMOUNT, THREE PHASE TRANSFORMER					
8	2 each	(E1527-00) TRANSFORMER 300 KVA 7200 277/480 PADMOUNT (tap changer +/-2.5%) with internal fault detector NL: LL: TL:			
9	1 each	(E1530-00) TRANSFORMER 750 KVA 7200 120/208 PADMOUNT (tap changer +/-2.5%) with internal fault detector NL: LL: TL:			
10	6 each	(E1532-00) TRANSFORMER 750 KVA 7200 277/480 PADMOUNT (tap changer +/-2.5%) with internal fault detector NL: LL: TL:			
11	5 each	(E1538-00) 2500 KVA 7200 277/480 PADMOUNT (tap changer +/-2.5%) with Internal Fault Detector NL: LL: TL:			

Note: The transformers shall be delivered FOB Brownsville Public Utilities Board, 1155 FM 511, Olmito, Texas 78575 **via open/flatbed trailer. Transformers shipped in an enclosed trailer will be rejected upon delivery.**

Special Instructions:

Attached are the latest approved drawings for transformer concrete pads. Please **use this as reference for the dimensions when building the unit(s)**. Underground (UD) **Concrete Pad Drawings are located on page 49**.

Price shall remain firm until an award is made and after original date of Purchase Order.
Put a “√” checkmark here: (), if able to keep price firm for a 90 day period.
If not, indicate length of time: _____.

Transformers shipped in an enclosed trailer will be rejected upon delivery.

Brownsville PUB has the right to increase or decrease quantities. In space below, stipulate whether the increase or decrease will affect bid price.

(____) Yes, an increase or decrease in quantity affects bid price.

(____) No, an increase or decrease in quantity will not affect bid price.

SPECIFY MANUFACTURER: _____

Company Name: _____

Company Address: _____

Authorized Company Representative: _____

Authorized Company Representative: _____

Signature – Failure to sign Bid will disqualify it

Company Address: _____

Telephone #: _____

Fax #: _____

E-mail: _____

BROWNSVILLE PUBLIC UTILITIES BOARD

BPUB Total Owning Cost Method (TOC) for Transformer Evaluation

For use in conjunction with RUS Bulletin 1724D-107

GUIDE FOR ECONOMIC EVALUATION OF DISTRIBUTION TRANSFORMERS

	Data
Demand Charge	\$43.86
Energy Charge	\$0.08719
Fixed Charge Rate	11.95%
Hours per year	8760
Capacity Factor	0.5
Peak Load Responsibility Factor	0.9
Energy Cost Increase per Year	2.5%
Average Inflation	2.60%
Interest Rate for Borrowing Money First	4.98%
Year Peak (%of nameplate Kva) Peak	80%
Load Growth per Year Expected	1.00%
Transformer Life in Years	35

Formula = Price + A* core loss (W) + B* coil loss (W)

A = \$9.795

B = \$2.670

Last Revision on: 12-6-24

BROWNSVILLE PUBLIC UTILITIES BOARD
SPECIFICATIONS AND CONDITIONS FOR
SINGLE PHASE POLE TYPE
DISTRIBUTION TRANSFORMERS
10 - 500 kVA

Transformers covered by these specifications shall be designed, manufactured and tested in accordance with the latest applicable ANSI and IEEE Standards except where they conflict with these specifications.

1.0 General

- 1.1 Purchase Order Contract will be issued for purchase supply of transformers.
- 1.2 Transformers will be ordered in releases as required to maintain a 90-day supply in the Brownsville PUB stock (NOT APPLICABLE).
- 1.3 Only the transformers as ordered, delivered and accepted will become due for payment.
- 1.4 Quantities indicated on the bid pricing sheet (attached) are estimated, based on usage history, and may vary by + or - 10%. The Brownsville PUB has the right to increase or decrease quantities as deemed necessary.
- 1.5 Bidders are asked **to hold price firm for 90 days from submission date** as per BPUB's Terms and conditions on Pages 5-6. All prices shall remain firm until an award is made and after original date of Purchase Order, if applicable, and must be FOB **Brownsville PUB Warehouse, 1155 FM 511, Olmito, TX 78575**.
- 1.6 Notification of Delivery: The Warehouse Administrator shall be notified at (956) 983-6181 or at (956) 983-6369 of the intended delivery forty-eight (48) hours prior to the actual delivery to the designated location, in order that the Owner's personnel and equipment may be available to accept delivery.
- 1.7 Delivery of transformers will only be accepted when delivered via an open trailer and during normal working hours, Monday thru Friday from 8:00 AM to 4:00 PM. **Transformers being delivered in an enclosed trailer will be rejected.** A delivery ticket must be furnished with each delivery by the carrier. The delivery ticket must show the BPUB's Purchase Order, number of crates, packages, etc. being delivered to the Owner. A packing list must be furnished with each delivery by the carrier. The packing list must include the BPUB's Purchase Order number, a description and the total number of transformers, size, etc. being delivered to BPUB.
- 1.8 Substitute items must be approved by the BPUB prior to shipment.
- 1.9 The Brownsville PUB reserves the right to refuse to accept any transformer not meeting these specifications or at its option to deduct a 10% discount on such units.
- 1.10 All transformers must have a reflective decal displaying the KVA of the transformer on the front. Decal shall be no more than 2 ½" x 4", Scotchlite Brand Reflective Sheeting.
- 1.11 All transformers **must have** the WARNING LABEL meeting the latest version of ANSI Standards/Rules.
- 1.12 Transformer sizes and voltages covered by these specifications:
 - 10 kVA - 500 kVA
 - 7200/12,470 Y - 120/240 volts, conventional
 - 240/480 volts, conventional
 - 277/480 volts, conventional

2.0 Ratings

2.1 Thermal Load Limits: Kilo-volt ampere ratings shall be in accordance with ANSI C57.12.25, Section 3.1 or latest revision.

2.2 Electrical Ratings: voltage and BIL ratings shall be as follows:

kVA Rating	Voltage Rating (HV-LV)	BIL (HV-LV)
10 -500	7200/12,470 Y - 120/240 volts	95 kV - 30 kV
	240/480 volts	95 kV – 30 kV
	277/480 volts	95 kV – 30 kV

2.3 Tap Ratings: Two 2 ½% taps below normal and Two 2 ½% taps above normal. Taps may not be required on transformers below 50 KVA (NOT APPLICABLE). Please reference COST SHEET for transformer specifications and amount.

2.4 BIL Testing: Each transformer shall pass a full wave impulse test in accordance with ANSI/IEEE C57.12.90 or latest revision.

2.5 Additional production line tests of each transformer shall include all tests as specified in ANSI C57.12.90 and no-load and load loss, impedance volts and excitation.

2.6 Transformer shall be constructed with interlaced secondary.

3.0 Paint: The finish of the exterior surface of the entire unit shall be sky gray weather resistant paint. The paint shall be weather resistant to mildew and ultraviolet chalking. The exterior finish shall conform to the latest EEI finishing guide lines.

4.0 Lifting Provisions: Two lifting lugs of adequate strength shall be provided on the sides of the tank near the top to provide a balanced lift.

5.0 Grounding Provisions: Two half inch, 7/16 inch deep grounding bosses shall be provided on the face of the tank. A grounding boss is to be just below the secondary neutral bushing and the other shall be near the bottom of the tank.

6.0 High voltage Bushings: Each transformer shall be furnished with two sky gray extra creepage high voltage bushings.

6.1 Low Voltage Bushings: Shall have porcelain insulation for all sizes and shall be of the eyebolt type connector for 75 kVA and below, and copper spades for 100 kVA and larger.

7.0 Low Voltage Bushings: A suitably sized, removable, external copper grounding strap shall be provided, connecting the bushing neutral terminal to a separate grounding boss on the tank.

8.0 Radio influence Voltage: The radio influence voltage (RIV) level shall not exceed 100 micro volts conducted at the high voltage bushings when the transformer is excited at 110% rated voltage and tested in accordance with NEMA 107.

9.0 All external electrical conducting parts or terminals used in the transformer are to be copper or copper alloys.

10.0 All transformers must have an approved pressure relief valve, threaded into a 1/2 inch NPT entrance into the tank.

- 11.0 Length of Warranty on transformers is to be one (1) year from installation or eighteen (18) months from shipment, whichever comes first.
- 12.0 The lid shall be secured to the tank with a 304 stainless steel clamping ring and hardware or approved equal.
- 13.0 Tap changer shall be externally operable.
- 14.0 Anti-tracking kits on high voltage bushings of transformers are required. These shall consist of a stainless steel collector ring at the bottom and top of the bushings. Collector ring located at the bottom of bushing should be physically connected to the transformer tank.
- 15.0 Each transformer to have one set of hanger brackets.
- 16.0 The bidder is to supply with the bid for evaluation purposes, the no load losses, load losses and total losses for the size of transformers to be quoted. All losses to be guaranteed average, tested according to ANSI. **Manufacturer is to furnish a certified test report within ninety (90) days of shipment for all units. The certified test report must reference Brownsville PUB Purchase Order Number.**

Send one set of the certified test reports to each department as noted below and must reference the bid number.

Electrical Engineering Department	and	Purchasing Department
Brownsville PUB		Brownsville PUB
1425 Robinhood Drive		1155 FM 511
Brownsville, Texas 78521		Olmito, Texas 78575

- 17.0 All transformers must have a reflective decal displaying the KVA of the transformer on the front. Decal shall be no more than 2 1/2" x 4", Scotchlite Brand Reflective Sheeting.
- 18.0 All transformers **must have** the WARNING LABEL meeting the latest version of ANSI Standards/Rules.

Public Utilities Board – 4/9/03

Single Phase Pole (10-500 KVA)

PUBLIC UTILITIES BOARD
SPECIFICATIONS AND CONDITIONS FOR
SINGLE PHASE PADMOUNT, DEAD FRONT
DISTRIBUTION TRANSFORMERS
25-167 KVA

Transformers covered by these specifications shall be designed, manufactured and tested in accordance with the latest applicable ANSI and IEEE Standards except where they conflict with these specifications.

1.0 General

- 1.1 Purchase Order Contract will be issued for Supply of transformers.
- 1.2 Supplier will maintain a minimum inventory of 1/4 of the quantity of transformers on contract at all times for immediate delivery (NOT APPLICABLE).
- 1.3 Transformers will be ordered as required to maintain a 90 day supply in the Brownsville PUB stock (NOT APPLICABLE).
- 1.4 Only the transformers as ordered, delivered and accepted will become due for payment. Brownsville PUB contemplates ordering semi-annually.
- 1.5 Quantities indicated on the bid pricing sheet (attached) are estimated, based on usage history, and may vary by + or — 10%. The Brownsville PUB reserves the right to increase or decrease quantities as deemed necessary.
- 1.6 Bidders are asked **to hold price firm for 90 days from submission date** as per BPUB's Terms and conditions on Pages 5-6. All prices shall remain until an award is made and after original date of Purchase Order, if applicable, and must be FOB **Brownsville PUB Warehouse, 1155 FM 511, Olmito, TX 78575**.
- 1.7 Notification of Delivery: The Warehouse Administrator shall be notified at (956) 983-6181 or at (956) 983-6369 of the intended delivery forty-eight (48) hours prior to the actual delivery to the designated location, in order that the Owner's personnel and equipment may be available to accept delivery.
- 1.8 Delivery of transformers will only be accepted when delivered via an open trailer and during normal working hours, Monday thru Friday from 8:00 AM to 4:00 PM. **Transformers being delivered in an enclosed trailer will be rejected.** A delivery ticket must be furnished with each delivery by the carrier. The delivery ticket must show the BPUB's Purchase Order, number of crates, packages, etc. being delivered to the Owner. A packing list must be furnished with each delivery by the carrier. The packing list must include the BPUB's Purchase Order number, a description and the total number of transformers, size, etc. being delivered to BPUB.
- 1.9 Substitute items must be approved by the BPUB prior to shipment.
- 1.10 The Brownsville PUB reserves the right to refuse to accept any transformer not meeting these specifications or at its option to deduct a 10% discount on such units.
- 1.11 All transformers **must have a reflective decal displaying** the KVA of the transformer on the front. Decal shall be no more than 2 ½" x 4", Scotchlite Brand Reflective Sheeting.
- 1.12 All transformers **must have** the WARNING LABEL meeting the latest version of ANSI

Standards/Rules.

- 1.13 Transformer sizes and voltages covered by these specifications:
25 KVA — 167 KVA 12,470 GRDY/7200 — 120/240 volts
- 2.0 Ratings
- 2.1 Thermal Load Limits: Kilo-volt ampere ratings shall be in accordance with ANSI C57. 12.25, Section 3.1 or latest revision.
- 2.2 Electrical Ratings: voltage and BIL ratings shall be as follows:
- | KVA Rating | Voltage Rating (HV-LV) | BIL | (HV-LV) |
|------------|-------------------------|---------------|---------|
| 25-167 | 12,470GRDY/7200-240/120 | 95 kV — 30 kV | |
- 2.3 Tap Ratings: Two 2 ½ % taps below normal and Two 2 ½% taps above normal.
- 2.4 BIL Testing: Each transformer shall pass a full wave impulse test in accordance with ANSI/IEEE C57. 12.90 or latest revision.
- 2.5 Additional production line tests of each transformer shall include all tests as specified in ANSI C57.12.90 and no-load and load loss, impedance volts and excitation.
- 2.6 Transformer windings shall be constructed with interlaced secondaries.
- 3.0 Construction.
- 3.1 General: The transformer tank and the terminating compartment shall be assembled as an integral unit. It shall be completely tamper-resistant without a need for additional housing, fencing, or other means of making the unit safe. The enclosure shall meet the requirements of the Western Underground Committee Guide No. 2.13 ‘Security for Padmounted Equipment Enclosures’.
- 3.2 Arrangement: All transformers shall be the ANSI Type II arrangement in accordance with Figure I or ANSI C57.12.25 and Drawing No.1 of this specification and shall be loop fed.
- 3.3 Oil: The electrical insulating and thermal cooling medium shall be transformer type mineral oil. All internal high voltage components shall be arranged such that they will remain under oil with the transformer tilted up to 10 in any direction.
- 3.4 Drainage: The roof of the assembled transformer unit shall drain freely such that no water will be able to drain into the terminating compartment, nor shall it stand on the transformer tank or compartment door(s).
- 3.5 Paint: The finish of the exterior surface of the entire unit and the interior of the terminating compartment shall be Munsell green weather resistant paint. The paint shall be resistant to mildew and ultraviolet chalking. The exterior finish shall conform to the latest EEL finishing guide lines.
- 3.6 Bottom Treatment: The flat part of the tank bottom shall not come in direct contact with the foundation surface. The tank bottom, the supports which are in contact with the foundation and the sill shall be treated with coal tar epoxy to prevent corrosion.

4.0 Terminating Compartment and Tank.

- 4.1 Sill: The sill below the compartment door shall be removable from inside the compartment allowing removal or installation of the unit without disturbing the entrance cables. The sill, lock pocket and hardware shall be 304 stainless steel. The hinges shall also be 304 stainless steel.
- 4.2 Security Provisions: The terminating compartment cover shall be provided with a means of padlocking the door to the sill. The door shall also be secured to the sill by a captive, recessed penta-head bolt. The provisions shall be arranged such that a padlock cannot be inserted until the penta-head bolt is fully engaged. This entire arrangement shall be recessed such that neither the padlocking provision nor the penta-head bolt will extend beyond the front plane of the compartment door.
- 4.3 Lifting Provisions: Recessed removable lifting lugs of adequate strength shall be provided on the sides of the tank near the top to provide a balanced lift.
- 4.4 Plugs: Two 1/2 inch minimum diameter plugs shall be provided on the face of the tank in the terminating compartment. The drain plug shall be located at the bottom and the liquid level plug shall be located at the 25° C oil level.
- 4.5 Grounding Provisions: Two 1/2 inch, 7/16 inch deep grounding bosses shall be provided on the face of the tank below the high voltage and low voltage bushings. Each boss shall be equipped with an approved grounding terminal having a clamping range of No.8 solid through 2/0 stranded. The location of the bosses is shown on Drawing No.1 of this specification. Approved grounding terminals are:

Penn Union	HGSE-020
Blackburn	TrC-3
Anderson	GTCS-34A

- 4.6 Exterior Grounding Provisions: Two 1/2 inch, 7/16 inch deep grounding bosses shall be provided on the exterior side walls of the transformer tank for use to ground pedestals by telephone company, etc. As an alternate, the manufacturer may provide a single threaded boss on the exterior rear wall of the transformer tank only if the transformer does not have cooling fins. The threaded portion of all the bosses shall be capped or plugged and free of paint and dirt.

5.0 Bushing and Terminals:

- 5.1 High Voltage Bushings: Each transformer shall have two 200 ampere bushing wells.
- 5.2 Low Voltage Bushings: Each transformer shall have three (3) low voltage bushings located in accordance with Drawing No.1 of these specifications. The low voltage neutral shall be brought out of the tank through a fully insulated bushing. A suitably sized, removable, external copper grounding strap shall be provided; connecting the neutral terminal to a separate grounding boss on the tank.
- 5.3 Low Voltage Terminals.
 - (a) 25 KVA through 75 KVA shall have threaded copper studs.
 - (b) 100 KVA through 167 KVA shall be NEMA Standard 4-hole tinned copper spades.
 - (c) One cable accessory parking stand shall be provided between the two high voltage

- bushing wells.
- (d) The appropriate terminal designation shall be indicated on the transformer tank. The marking shall be permanent and shall include H1A, H1B, X1, X2, and X3.

- 6.0 Fusing: The high voltage fusing shall consist of the bayonet type. All bayonet housings must be permanently marked with the manufacturer's name and year of manufacture. Fuses shall be sized to carry full load rating of the transformer winding.
- 7.0 Radio Influence Voltage: The radio influence voltage (RJV) level shall not exceed 100 micro volts conducted at the high voltage bushing wells when the transformer is excited at 110% rated voltage and tested in accordance with NEMA 107.
- 8.0 Length of Warranty on transformers is to be one (1) year from installation or eighteen (18) months from shipment whichever comes first.
- 9.0 Tap changer shall be externally operable.

The bidder is to supply with the bid for evaluation purposes, the no load losses, load losses and total losses for the size of transformers to be quoted. All losses to be guaranteed average, tested according to ANSI. **Manufacturer is to furnish a certified test report within 90 days of shipment for all units. The certified test report must reference Brownsville PUB Purchase Order Number.**

Send one set of the certified test reports to each department as noted below and must reference the bid number.

Electrical Engineering Department and
Brownsville PUB
1425 Robinhood Drive
Brownsville, Texas 78521

Purchasing Department
Brownsville PUB
1155 FM 511
Olmito, Texas 78575

BROWNSVILLE PUBLIC UTILITIES BOARD SPECIFICATION
PADMOUNT TRANSFORMER FUSING

<u>Transformer Size (KVA)</u>	<u>Bay-O-Net Fuse Rte. Cat. No.</u>
45	4000358C03
75	4000358C05
112.5	4000358C08
150	4000358C08
225	4000358C10
300	4000358C10
500	4000358C12
750	4000358C14
1000	4000358C14
1500	4000353C17
2000	4000353C17
2500	4000353C17

CERTIFICATION OF COMPLIANCE

Vendors shall supply, prior to bidding, certified test results to qualify the quality of the product being supplied for approval.

1. Cabinet security test per Western Underground Committee Guide 2.13/04/0279.
2. Proof of compliance with latest revision of the EEI Finishing Guidelines for Padmounted Equipment.
3. Short Circuit Testing:

The manufacturer shall supply certified test reports to verify that their design has passed short circuit criteria per ANSI C57.12.00 and ANSI C57.12.90, latest revision. The written report shall include pretest impedance, post test impedance, percent change, identification of unit tested and the date of the test. **The certified test report must reference Brownsville PUB Purchase Order Number.**

Send one set of the certified test reports to each department as noted below and referenced the bid number.

Electrical Engineering Department	and	Purchasing Department
Brownsville PUB		Brownsville PUB
1425 Robinhood Drive		1155 FM 511
Brownsville, Texas 78521		Olmito, Texas 78575

**BROWNSVILLE PUBLIC UTILITIES BOARD
SPECIFICATIONS FOR **THREE PHASE**
PADMOUNTED DISTRIBUTION TRANSFORMERS
45 KVA THROUGH 2500 KVA**

1.0 GENERAL

- 1.01 This specification covers the electrical characteristics and mechanical features of three phase, 60 Hertz, wye-wye or wye-delta (as specified) connected, mineral oil immersed, self-cooled, padmounted compartmental type transformers, rated 45 kVA through 2500 kVA @65°C temperature rise above ambient.
- 1.02 All characteristics, definitions, and terminology, except as specifically covered in this specification shall be in accordance with the latest revision of the NEMA, IEEE, ANSI and IEEE standards and in particular C57.12.00, C57.12.10, C57.12.22, C57.12.26, C57.12.28, C57.12.70, C57.12.80, C57.12.90.
- 1.03 Purchase Order Contract will be issued for the 3 Phase Padmount transformers.
- 1.04 Transformers will be ordered in releases as required to maintain a 90 day supply in the Brownsville PUB stock (NOT APPLICABLE).
- 1.05 Only the transformers as ordered, delivered and accepted will become due for payment. Brownsville PUB contemplates ordering semi-annually (Not Applicable).
- 1.06 Quantities indicated on the bid pricing sheet (attached) are estimated, based on usage history, and may vary by + or — 10%. The Brownsville PUB reserves the right to increase or decrease quantities as deemed necessary.
- 1.07 Bidders are asked **to hold price firm for 90 days from submission date** as per BPUB's Terms and conditions on Pages 5-6. All prices shall remain firm until an award is made and after original date of Purchase Order, if applicable, and must be **FOB Brownsville PUB Warehouse, 1155 FM 511, Olmito, TX 78575**.
- 1.08 Notification of Delivery: The Warehouse Administrator shall be notified at (956) 983-6181 or at (956) 983-6369 of the intended delivery forty-eight (48) hours prior to the actual delivery to the designated location, in order that the Owner's personnel and equipment may be available to accept delivery.
- 1.09 Delivery of transformers will only be accepted when delivered via an open trailer and during normal working hours, Monday thru Friday from 8:00 AM to 4:00 PM. **Transformers being delivered in an enclosed trailer will be rejected.** A delivery ticket must be furnished with each delivery by the carrier. The delivery ticket must show the BPUB's Purchase Order, number of crates, packages, etc. being delivered to the Owner. A packing list must be furnished with each delivery by the carrier. The packing list must include the BPUB's Purchase Order number, a description and the total number of transformers, size, etc. being delivered to BPUB.
- 1.10 The Brownsville PUB reserves the right to refuse to accept any transformer not meeting these specifications or at its option to deduct a 10% discount on such units.
- 1.11 Substitute items must be approved by the BPUB prior to shipment.
- 1.12 All transformers must have the WARNING LABEL meeting the latest version of ANSI

Standards/Rules.

2.0 **INSULATION LEVEL**

2.01 The high voltage insulation shall be:

<u>Rated High Voltage (Volts)</u>	<u>BIL (kV)</u>	<u>Insulation (kV)</u>
12470 GY/7200	95	15
12470 Y/7200	95	15

2.02 The low voltage insulation level shall be as follows:

<u>Low Voltage Rating (Volts) (kV)</u>	<u>BIL (kV)</u>	<u>Insulation</u>
208Y/120	30	1.2
480Y/277	30	1.2
240Δ/120	30	1.2
2400Δ	45	2.5

3.0 **HIGH VOLTAGE TAPS**

3.01 All ratings shall be provided with high voltage taps as shown below:

<u>Low Voltage Rating</u>	<u>KVA</u>	<u>Above and/or Below Rated Voltage</u>
208Y/120	All	Two 2 ½% above, Two 2 ½% below
480Y/277	All	Two 2 ½% above, Two 2 ½% below
240Δ/120	All	Two 2 ½% above, Two 2 ½% below
2400Δ	All	Two 2 ½% above, Two 2 ½% below

The tap changer handle shall be mounted for external operation and located in the high voltage compartment. Handle shall be shot gun stick operable. Mechanism shall be rated at 200 continuous load for 45 KVA through 1000 KVA and 150% continuous loading for 1500 KVA and higher.

4.0 **TEMPERATURE RISE LIMITS**

4.01 The transformer shall be provided with a five legged core or a triplex design so that excessive tank heating will not occur during unbalanced loading conditions or loss of one phase.

4.02 The winding rise above ambient temperature shall not exceed 65°C when tested in accordance with the ratings.

4.03 The hot spot temperature rise above ambient temperature shall not exceed 80°C when tested in accordance with their ratings.

5.0 **IMPEDANCE**

5.01 The percent impedance voltage as measured on the rated voltage connection shall be as follows:

<u>KVA Rating</u>	<u>Impedance</u>
45-500	2.0% - 5.0%
750-2500	5.75% ± 7.5%

6.0 **TESTING**

6.01 The manufacturer shall perform the following tests on 100% of the units supplied. The testing shall be in accordance with ANSI C57.12.90.

Ratio
Polarity
Exciting Current
Impedance
No-Load (Core) Losses
Induced Potential (Over-Excitation)
Applied Potential (Primary and Secondary)
Leak Test

6.02 Certified test reports shall be provided by serial number on each unit shipped. The reports shall contain, as a minimum, the following information:

Percent Impedance
Percent Exciting Current
No-Load Loss @ 85°C
Load Loss @85°C
Total Loss @85°C
Induced Potential Certification
Applied Potential Certification
Oil Certification Per Par. 7.00

7.0 **OIL**

The liquid supplied in these transformers shall be non-PCB type, as defined by Federal Regulation No. 40CFR 761, dated May 31, 1979. The liquid contained in these transformers shall be identified as a non-PCB type containing less than 2 ppm. The data shall be on the nameplate on the transformer.

8.0 **CONSTRUCTION**

8.01 **Core and Coil Construction**

The transformer coils shall be designed to maintain their nameplate KVA rating throughout the temperature range. All materials used shall be of the 65°C (80°C Hot Spot) Class and be thoroughly tested for compatibility with all transformer components before inserted into design. Only thermally upgraded, one hundred percent conduction particle tested Kraft paper shall be used for secondary layer insulation. Provision shall be provided to securing sheet windings and also the primary winding in their position during construction and also short circuit conditions. Either diamond pattern, thermal setting adhesive type paper or cuffing of the insulation is acceptable.

Oil ducts shall be strong enough to withstand full short circuit forces. Fiber pressboard ducts or processed hardwood maple sticks shall be used for the oil ducts. No other material will be accepted.

The cores shall be manufactured from grain oriented silicon steel laminations, coated with a glass-hard insulation to prevent sheet-to-sheet shortings and shall be deburred before forming into final shape. The cores shall be fully annealed or stacked design to relieve stresses incurred during manufacturing process.

8.011 Core-Coil Assembly

The core and coil, after assembly, shall be mounted in a rigid steel frame, constructed in such a way as to hold the coil in a rigid position within the core window without placing undue stress on the core or short circuit the laminations at any point. No wood other than processed hardwood maple shall be used in core-coil assembly and then only in proper ratio with other materials.

8.02 General

8.021 The padmounted compartmental type transformers shall consist of the transformer tank and compartment shall be assembled as an integral unit. The transformer doors and compartments shall be constructed in accordance with ANSI C57.12.28, latest revision.

8.022 Transformers shall be furnished without clam-shell doors, flip top door, or any doors without stainless steel hinges.

8.035 All exterior nuts and bolts shall be of a corrosion resistant material.

8.024 The unit shall be painted Munsell #7GY 3.29/1.5 Green. Paint shall be of such quality so that it will conform to the latest revision of the EEI Finishing Guidelines for Padmounted Equipment. Provide prices (optional) for this type of coating: Amerlock II Series 400 epoxy based premier at least 5 mils thick with a topcoat of PPG's PSX 1001 Series single pack acrylic polysiloxane at least 3 mils thick for color retention (Option I on Cost Sheet).

8.025 All transformers must have a reflective decal displaying the KVA of the transformer on the front. Decal shall be no more than 2 ½" x 4", Scotchlite Brand Reflective Sheeting.

8.03 Bushings and Terminals

8.031 The bushings and terminals shall be located in accordance with Figures 6, 7, and 8A of ANSI C57.12.26, latest revision.

8.032 The transformer shall be provided with six high voltage bushing wells (ANSI/IEEE 386, latest revision), externally clamped, and with 8 parking stands to permit operating the transformer from a looped primary system. High voltage lead lengths shall be of such lengths as to permit field replacement of bushing wells (RTE Part #2603973B01 or pre-approved equal). On wye-delta transformers, Ho connection will be internal only, not brought out on a bushing.

8.033 Parking stands shall be located in accordance with Figure 6 of ANSI C57.12.26, latest revision.

8.034 Low voltage line and neutral bushings shall be fully insulated externally clamped copper Spades. The spade bushing shall be integral in construction with: a six-hole terminal on 500 KVA and below transformers; a 12-hole terminal on 750 KVA and above transformers. All terminals shall be in tin plated copper and conform to Fig. 9b on ANSI C57.12.26. All spades shall be supported with external insulated brackets to relieve stress on low voltage bushings and gaskets, as per attached Fig. 1.

8.035 The low voltage neutral bushing shall be an insulated bushing with the removable external Ground connection. The ground strap shall be adequate to carry the fault current based on the rating of the transformer.

8.04 Internal Bushing Leads

8.041 High voltage bushing leads shall be trained and appropriately insulated to avoid dielectric breakdown between adjacent cables. Spacers, permanently held in place, should be used to prevent cables from failing phase to phase or phase to ground.

8.042 Low voltage bushing leads made of aluminum shall be welded in place using a gas metal arc welding process. The use of a welding technique similar to one known as “the fore-hand and vertical-up technique” will eliminate porosity of the weld head. This will create a good electrical and strong (mechanical) connection. Low voltage bushing leads made of copper shall be “brazed” together or cold welded.

8.05 Fusing

8.051 The transformers shall be equipped with three Bay-O-Net draw-out use holders and expulsion fuses. See attached fuse table.

8.052 Bay-O-Net fuse holder assembly shall be placed so that the fuses may be removed by a Person using hot stick without having to raise or remove the primary compartment cover.

8.053 An oil drip shield (metal) shall be furnished directly beneath the Bay-O-Net fuse.

8.06 High Voltage & Low Voltage Compartments

8.061 Doors on the high voltage and low voltage compartments shall be of sufficient size to provide adequate working space when opened.

8.062 With the low voltage compartment door opened or removed, the high voltage shall be protected by adequate safeguards. Access to the high voltage compartment shall not be attained until some specific action is taken, such as releasing a pentahead bolt to allow the compartment door to be opened. The barrier separating the two compartments shall be of such material which would retain its rigidity over the life of the unit. If an insulating material is used for the barrier, it shall be supported or braced on all sides with metal strips.

8.07 Switching

8.071 A three phase gang operated four position under oil loadbreak switch shall be supplied on all transformers (see drawing on page 34). The switch shall have a loadbreak rating of 600 amperes and a 3-shot make and latch rating of 10,000 amperes symmetrical. The connections to be made in each switching position are as follows:

Position 1: Source A, Source B, Transformer Coils

Position 2: Source A, Transformer Coils

Position 3: Source B, Transformer Coils

Position 4: Source A, Source B, Coils Disconnected

The switch handle, located in the primary compartment, shall be capable of being operated with a hot stick. The switch is to be RTE part #220913C61M or approved equivalent.

8.08 Accessory Equipment

8.081 The following equipment and devices shall be provided on 500 KVA and larger units:

- 1) Oil drain valve with sampling device located in the high voltage compartment.
- 2) Liquid level gauge in low voltage compartment.
- 3) Temperature indicator in low voltage compartment.

8.082 The transformer shall be supplied with a pressure relief device located on the low voltage side of the terminal compartment. The device shall be capable of automatically venting 50 scfm @ 15 psi. The operating pressure shall be 10 ± 1 psi with reseal at 8 ± 1 psi.

8.09 Handling and Mounting Facilities

8.091 Rolling provision. The transformer base shall be arranged for rolling in two directions parallel to and at right angles to the centerline of the high voltage bushings.

- 8.092 Lifting provision shall be in accordance with ANSI C57.12.26.
- 8.09.3 Mounting provision. The base of the assembly shall be provided with a suitable flange to permit anchoring the unit on the pad from within the cable terminating compartments.

8.10 Terminal Marking and Angular Displacement

- 8.10.1 Terminal designations shall be defined by American National Standard C57.12.70, Terminal Markings for Electrical Apparatus, with each terminal clearly marked with oil resistant yellow paint.
- 8.11.1 The identification of terminal connections shall be shown on the instruction nameplate.
- 8.103 The angular displacement between the high and low voltage windings on wye-delta units shall be thirty degrees.

8.11 Instruction Nameplate

- 8.11.1 The instruction nameplate shall be located at a convenient spot on the inside of the low voltage compartment and shall be readable with cables in place.
- 8.12.1 The information specified in Table 7 (nameplate B) of ANSI Standard C57.12.00, latest revision thereof, shall be permanently shown on the instruction nameplate.
- 8.13.1 The nameplate shall be made of a corrosion resistant material.
- 8.14.1 The nameplate shall show the type of material in the HV and LV coils.
- 8.15.1 The nameplate shall show the PCB content to be less than 2 ppm.
- 8.16.1 Manufacturer needs to provide actual PCB concentration of mineral oil on the **NAMEPLATE**. Simply labeling transformers **Non-PCB** is not sufficient, actual concentration needed (i.e. <1 ppm PCB).
- 8.17.1 Manufacturer needs to provide certification indicating the concentration of PCBs in their transformers.

8.12 Oil Preservation

- 8.12.1 A sealed tank system shall be standard on all transformers.
- 8.122 A sealed tank system is one in which the interior of the transformer will be sealed from the atmosphere throughout its top oil temperature range, and in which the gas plus the oil volume remain constant. The transformers will remain effectively sealed throughout a top oil temperature range of -5°C to +105°C provided the initial level has been properly adjusted.

8.13 Tanks

- 8.13.1 The tank shall be of sufficient strength to withstand a pressure of 7 psi gauge, without permanent distortion. A 1” pipe plug for filling and pressure testing shall be provided.

- 8.14.1 Tank covers may be either the bolted-on or welded-on type. The bolted-on cover shall have provisions to make it tamperproof or tamper resistance. The weld-on cover shall have an access hole which has an opening of sufficient size to permit removal of core/coil assembly as a unit. The access hole shall have a bolted-on cover with a tamperproof false cover over it.
- 8.15.1 Tank grounding shall be in accordance with ANSI Standard C57.12.26.

9.0 OTHER

- 9.01 No deviation from these specifications on the part of the bidder will be accepted unless approved in writing prior to submission of bid. Any items supplied under these specifications not in complete compliance with these specifications shall be unacceptable and returned to the vendor at the vendor's expense.
- 9.02 The manufacturer must have on file with the BPUB approved drawings or shall submit detail manufacturing drawings to the BPUB Purchasing Department for approval of each size transformer to be supplied under this specification. Revision to these drawings must be approved prior to delivery of any transformer not conforming to accepted drawings.
- 9.03 Notification of any changes in the manufacturing process, materials or component parts shall be provided by the vendor and approved by the BPUB **prior** to delivery of any units. Both the notification and approval must be in writing to:

Transmission & Distribution Division, Eli Alvarez, Brownsville PUB, 1425 Robinhood Drive, Brownsville, Texas 78521 (956) 983-6234
- 9.04 All manufacturers furnishing transformers under these specifications shall supply at least 5% of the distribution transformer market and have at least 10 years experience in the manufacture and sales of distribution transformers.
- 9.05 Any transformers furnished not meeting these specifications will be returned to the vendor at the vendor's expense. In the event BPUB chooses to use those units because of its needs, it will deduct 10% of the purchase price as liquidated damages, in addition to any other expenses it incurs to make the unit useable.
- 9.06 Approval drawings (mfg.) are required on any specification changes.

BROWNSVILLE PUBLIC UTILITIES BOARD SPECIFICATION
PADMOUNT TRANSFORMER FUSING

<u>Transformer Size (KVA)</u>	<u>Bay-O-Net Fuse Rte. Cat. No.</u>
46	4000358C03
76	4000358C05
112.6	4000358C08
151	4000358C08
226	4000358C10
301	4000358C10
501	4000358C12
751	4000358C14
1001	4000358C14
1501	4000353C17
2001	4000353C17
2501	4000353C17

CERTIFICATION OF COMPLIANCE

Vendors shall supply, prior to bidding, certified test results to qualify the quality of the product being supplied for approval.

4. Cabinet security test per Western Underground Committee Guide 2.13/04/0279.
5. Proof of compliance with latest revision of the EEI Finishing Guidelines for Padmounted Equipment.
6. Short Circuit Testing:




The manufacturer shall supply certified test reports to verify that their design has passed short circuit criteria per ANSI C57.12.00 and ANSI C57.12.90, latest revision. The written report shall include pretest impedance, post test impedance, percent change, identification of unit tested and the date of the test. **The certified test report must reference Brownsville PUB Purchase Order Number.**

Send one set of the certified test reports to each department as noted below and referenced the bid number.

Electrical Engineering Department and
Brownsville PUB
1425 Robinhood Drive
Brownsville, Texas 78521

Purchasing Department
Brownsville PUB
1155 FM 511
Olmito, Texas 78575


DRAWING N°1

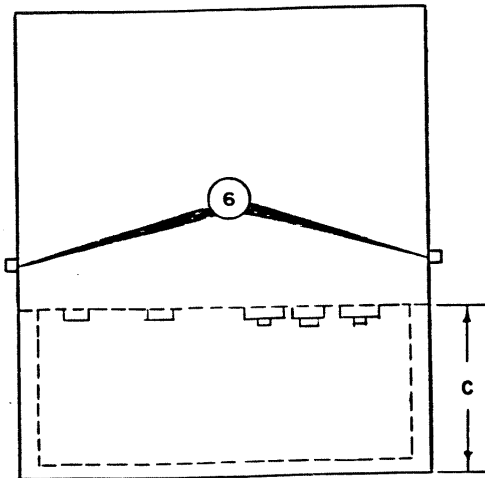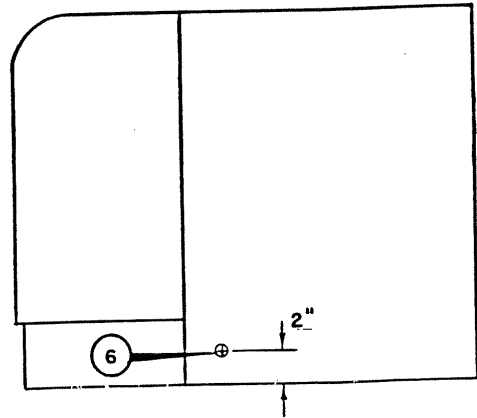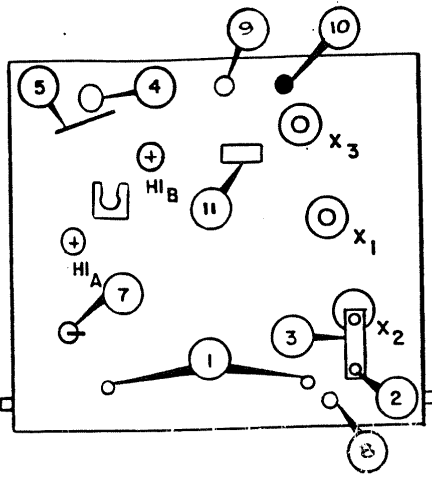

- ① TANK GROUNDING TERMINALS —
- ② X2 GROUND BOSS
- ③ X2 GROUNDING STRAP —
- ④ BAYONET FUSEHOLDER
- ⑤ OIL DRIP SHIELD
- ⑥ GROUND BOSSES
- ⑦ TAP CHANGER
- ⑧ OIL DRAIN PLUG
- ⑨ OIL FILL PLUG
- ⑩ PRESSURE RELIEF DEVICE
- ⑪ NAMEPLATE

1Ø PAD MOUNTED DEAD FRONT
TRANSFORMER ANSI TYPE-II

Public Utilities Board



P.O. Box 3270
Brownsville, Texas
78520

1	1/85	P.V.	ANSI-I TO ANSI-II
2	5/95	S.G.	ADD ITEM 8-11
REV	DATE	BY	SUBJECT

ELECTRIC ENGINEERING DEPT	
DRAWN BY: <i>PL</i>	APPROVED BY: <i>Y.C.C.</i>
DATE: 4-25-83	SCALE: <i>N/A</i>
DRAWING NUMBER:	SHEET NUMBER: 1

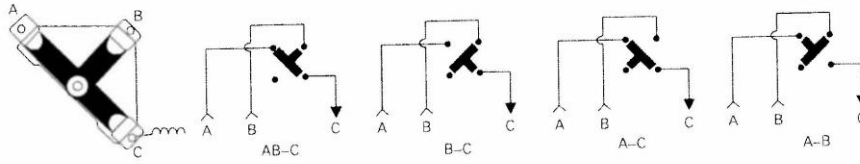


Figure 27. T-blade switch function.

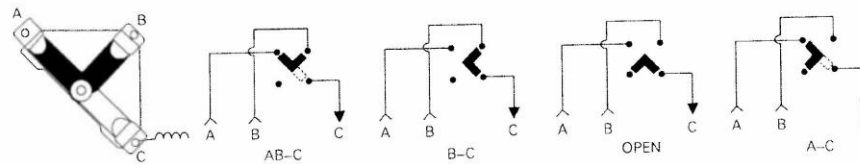



Figure 28. V-blade switch function.

Cooper Power Systems Arc Strangler® Switch

Transformers may be equipped with either radial or loop-feed Arc Strangler switches mounted in the high-voltage compartment. These switches are equipped with current-limiting fuses. The Arc Strangler must be cocked before a switch or fuse assembly can be closed. Follow the Cooper Power Systems instructions for operating these devices. The load-break function is provided by either fuses or blades.

S&C Pad-Mounted Gear

When S&C air switches or fused disconnects are used, follow the manufacturer's instructions for operation. When operated with the S&C loadbuster tool, these disconnects function as loadbreak switches.



WARNING: Use the S&C loadbuster tool to operate the switch or fused disconnect. Failure to comply may result in serious personal injury or death.

REQUIRED FORMS CHECKLIST

The following forms are to be submitted as a part of the Bid/RFP/RFQ document

NAME	FORM DESCRIPTION	SUBMITTED WITH BID	
		YES	NO
Legal Notice	Acknowledgement Form	<input type="checkbox"/>	<input type="checkbox"/>
	Debarment Certification	<input type="checkbox"/>	<input type="checkbox"/>
	Ethics Statement	<input type="checkbox"/>	<input type="checkbox"/>
	Conflict of Interest Questionnaire	<input type="checkbox"/>	<input type="checkbox"/>
	Certification of Interested Party Form 1295	<input type="checkbox"/>	<input type="checkbox"/>
	Residence Certification	<input type="checkbox"/>	<input type="checkbox"/>
	State Law Verification	<input type="checkbox"/>	<input type="checkbox"/>
	House bill 89 Verification	<input type="checkbox"/>	<input type="checkbox"/>
	W9 or W8 Form	<input type="checkbox"/>	<input type="checkbox"/>
Special Instructions	Bid Schedule/Cost sheet completed and signed	<input type="checkbox"/>	<input type="checkbox"/>
	Cashier Check or Bid Bond of 5% of Total Amount of Bid (if applicable)	<input type="checkbox"/>	<input type="checkbox"/>
	OSHA 300 Log (if applicable)	<input type="checkbox"/>	<input type="checkbox"/>
	Contractor Pre-Bid Disclosure completed, signed and notarized (if applicable)	<input type="checkbox"/>	<input type="checkbox"/>
	Sub-Contractor Pre-Bid Disclosure completed, signed, and notarized (if applicable)	<input type="checkbox"/>	<input type="checkbox"/>
References	Complete the Previous Customer Reference Worksheet for each reference provided	<input type="checkbox"/>	<input type="checkbox"/>
Addenda			

CERTIFICATION REGARDING DEBARMENT, SUSPENSION, AND OTHER RESPONSIBILITY MATTERS (THIS FORM MUST BE COMPLETED IN ITS ENTIRETY AND SUBMITTED WITH BID RESPONSE)

Name of Entity: _____

The prospective participant certifies to the best of their knowledge and belief that they and their principals:

- a) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal department or agency;
- b) Have not within a three year period preceding this bid been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State, or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;
- c) Are not presently indicted for or otherwise criminally or civilly charged by a government entity (Federal, State, Local) with commission of any of the offenses enumerated in paragraph (1) (b) of this certification; and
- d) Have not within a three year period preceding this application/bid had one or more public transactions (Federal, State, Local) terminated for cause or default.

I understand that a false statement on this certification may be grounds for rejection of this bid or termination of the award. In addition, under 18 USC Section 1001, a false statement may result in a fine up to a \$10,000.00 or imprisonment for up to five (5) years, or both.

Name and Title of Authorized Representative (Typed)

Signature of Authorized Representative

Date

I am unable to certify to the above statements. My explanation is attached.

ETHICS STATEMENT (THIS FORM MUST BE COMPLETED IN ITS ENTIRETY AND SUBMITTED WITH BID RESPONSE)

The undersigned bidder, by signing and executing this bid, certifies and represents to the Brownsville Public Utilities Board that bidder has not offered, conferred or agreed to confer any pecuniary benefit, as defined by (1.07 (a) (6) of the Texas Penal Code, or any other thing of value as consideration for the receipt of information or any special treatment of advantage relating to this bid; the bidder also certifies and represents that the bidder has not offered, conferred or agreed to confer any pecuniary benefit or other thing of value as consideration for the recipient's decision, opinion, recommendation, vote or other exercise of discretion concerning this bid, the bidder certifies and represents that bidder has neither coerced nor attempted to influence the exercise of discretion by any officer, trustee, agent or employee of the Brownsville Public Utilities Board concerning this bid on the basis of any consideration not authorized by law; the bidder also certifies and represents that bidder has not received any information not available to other bidders so as to give the undersigned a preferential advantage with respect to this bid; the bidder further certifies and represents that bidder has not violated any state, federal, or local law, regulation or ordinance relating to bribery, improper influence, collusion or the like and that bidder will not in the future offer, confer, or agree to confer any pecuniary benefit or other thing of value of any officer, trustee, agent or employee of the Brownsville Public Utilities Board in return for the person having exercised their person's official discretion, power or duty with respect to this bid; the bidder certifies and represents that it has not now and will not in the future offer, confer, or agree to confer a pecuniary benefit or other thing of value to any officer, trustee, agent, or employee of the Brownsville Public Utilities Board in connection with information regarding this bid, the submission of this bid, the award of this bid or the performance, delivery or sale pursuant to this bid.

THE VENDOR SHALL DEFEND, INDEMNIFY, AND HOLD HARMLESS THE BROWNSVILLE PUBLIC UTILITIES BOARD, ALL OF ITS OFFICERS, AGENTS AND EMPLOYEES FROM AND AGAINST ALL CLAIMS, ACTIONS, SUITS, DEMANDS, PROCEEDING, COSTS, DAMAGES, AND LIABILITIES, ARISING OUT OF, CONNECTED WITH, OR RESULTING FROM ANY ACTS OR OMISSIONS OF CONTRACTOR OR ANY AGENT, EMPLOYEE, SUBCONTRACTOR, OR SUPPLIER OF CONTRACTOR IN THE EXECUTION OR PERFORMANCE OF THIS BID.

I have read all of the specifications and general bid requirements and do hereby certify that all items submitted meet specifications.

COMPANY: _____

AGENT NAME: _____

AGENT SIGNATURE: _____

ADDRESS: _____

CITY: _____

STATE: _____ ZIP CODE: _____

TELEPHONE: _____ TELEFAX: _____

FEDERAL ID#: _____ AND/OR SOCIAL SECURITY #: _____

DEVIATIONS FROM SPECIFICATIONS IF ANY:

NOTE: QUESTIONS AND CONCERNS FROM PROSPECTIVE CONTRACTORS SHOULD BE RAISED WITH OWNER AND ITS CONSULTANT (IF APPLICABLE) AND RESOLVED IF POSSIBLE, PRIOR TO THE BID SUBMITTAL DATE. ANY LISTED DEVIATIONS IN A FINALLY SUBMITTED BID MAY ALLOW THE OWNER TO REJECT A BID AS NON-RESPONSIVE.

CONFLICT OF INTEREST QUESTIONNAIRE
For vendor doing business with local governmental entity

A complete copy of Chapter 176 of the Local Government Code may be found at <http://www.statutes.legis.state.tx.us/Docs/LG/htm/LG.176.htm>. For easy reference, below are some of the sections cited on this form.

Local Government Code § 176.001(1-a): "Business relationship" means a connection between two or more parties based on commercial activity of one of the parties. The term does not include a connection based on:

- (A) a transaction that is subject to rate or fee regulation by a federal, state, or local governmental entity or an agency of a federal, state, or local governmental entity;
- (B) a transaction conducted at a price and subject to terms available to the public; or
- (C) a purchase or lease of goods or services from a person that is chartered by a state or federal agency and that is subject to regular examination by, and reporting to, that agency.

Local Government Code § 176.003(a)(2)(A) and (B):

(a) A local government officer shall file a conflicts disclosure statement with respect to a vendor if:

(2) the vendor:

(A) has an employment or other business relationship with the local government officer or a family member of the officer that results in the officer or family member receiving taxable income, other than investment income, that exceeds \$2,500 during the 12-month period preceding the date that the officer becomes aware that

- (i) a contract between the local governmental entity and vendor has been executed;
- or
- (ii) the local governmental entity is considering entering into a contract with the vendor;

(B) has given to the local government officer or a family member of the officer one or more gifts that have an aggregate value of more than \$100 in the 12-month period preceding the date the officer becomes aware that:

- (i) a contract between the local governmental entity and vendor has been executed; or
- (ii) the local governmental entity is considering entering into a contract with the vendor.

Local Government Code § 176.006(a) and (a-1)

(a) A vendor shall file a completed conflict of interest questionnaire if the vendor has a business relationship with a local governmental entity and:

- (1) has an employment or other business relationship with a local government officer of that local governmental entity, or a family member of the officer, described by Section 176.003(a)(2)(A);
- (2) has given a local government officer of that local governmental entity, or a family member of the officer, one or more gifts with the aggregate value specified by Section 176.003(a)(2)(B), excluding any gift described by Section 176.003(a-1); or
- (3) has a family relationship with a local government officer of that local governmental entity.

(a-1) The completed conflict of interest questionnaire must be filed with the appropriate records administrator not later than the seventh business day after the later of:

- (1) the date that the vendor:
 - (A) begins discussions or negotiations to enter into a contract with the local governmental entity; or
 - (B) submits to the local governmental entity an application, response to a request for proposals or bids, correspondence, or another writing related to a potential contract with the local governmental entity; or
- (2) the date the vendor becomes aware:
 - (A) of an employment or other business relationship with a local government officer, or a family member of the officer, described by Subsection (a);
 - (B) that the vendor has given one or more gifts described by Subsection (a); or
 - (C) of a family relationship with a local government officer.

INTERESTED PARTIES-FORM 1295

Special message: Please read the Special Notification regarding HB 1295 effective January 1, 2016, implemented by the Texas Ethics Commission, which requires business entities to provide a completed Form 1295 to Brownsville PUB with signed contracts in order to execute them.

In 2015, the Texas Legislature adopted House Bill 1295. The law states that a governmental entity or state agency may not enter into certain contracts with a business entity unless the business entity submits a disclosure of interested parties to the governmental entity or state agency at the time the business entity submits the signed contract to the governmental entity or state agency. The law applies to a contract of a governmental entity or state agency that either (1) requires an action or vote by the governing body of the entity or agency before the contract may be signed or (2) has a value of at least \$1 million. The disclosure requirement applies to a contract entered into on or after January 1, 2016.

To implement the law, the Texas Ethics Commission (TEC) adopted new rules necessary to prescribe the disclosure of interested parties form, and post a copy of the form on the commission's website. The commission adopted the Certificate of Interested Parties form, Form 1295, on October 5, 2015. The commission also adopted new rules as part of Chapter 46 of the Texas Administrative Code on November 30, 2015.

On January 1, 2016, TEC made a new filing application available on their website for business entities to use to both create and file Form 1295. Business entities will enter the required information on Form 1295 within the application and print a copy of the completed form, which will include a certification of filing with a unique certification number. An authorized agent of the business entity will need to sign the printed copy of the form and have the form notarized. The completed Form 1295 with the certification of filing must be included with the signed contract to the governmental body or state agency in order for the governmental body to execute the contract.

Brownsville PUB will then notify the commission, using TEC's filing application, of the receipt of the filed Form 1295 with the certification of filing not later than the 30th day after the date the contract binds all parties to the contract.

TEC will then post the business entity's completed Form 1295 to its website within seven (7) business days after receiving notice from Brownsville PUB acknowledging that it was received.

To obtain additional information on HB 1295, to learn more about TEC's process to create a new account or to complete an electronic version of Form 1295 for submission with a signed contract, please go to the following link: https://ethics.state.tx.us/whatsnew/elf_info_form1295.htm

NOTE: IF AWARDED THIS CONTRACT, FORM 1295 WILL BE SUBMITTED AT THE TIME THE SIGNED CONTRACT IS SUBMITTED TO BPUB. YES NO

CERTIFICATE OF INTERESTED PARTIES

FORM 1295

Complete Nos. 1 - 4 and 6 if there are interested parties.
 Complete Nos. 1, 2, 3, 5, and 6 if there are no interested parties.

OFFICE USE ONLY

1 Name of business entity filing form, and the city, state and country of the business entity's place of business.

2 Name of governmental entity or state agency that is a party to the contract for which the form is being filed.

3 Provide the identification number used by the governmental entity or state agency to track or identify the contract, and provide a description of the goods or services to be provided under the contract.

4 Name of Interested Party	City, State, Country (place of business)	Nature of Interest (check applicable)	
		Controlling	Intermediary

5 Check only if there is NO Interested Party.

6 UNSWORN DECLARATION

My name is _____, and my date of birth is _____.

My address is _____, _____, _____, _____, _____.
 (street) (city) (state) (zip code) (country)

I declare under penalty of perjury that the foregoing is true and correct.

Executed in _____ County, State of _____, on the _____ day of _____, 20____.
 (month) (year)

 Signature of authorized agent of contracting business entity
 (Declarant)

ADD ADDITIONAL PAGES AS NECESSARY

BROWNSVILLE PUBLIC UTILITIES BOARD
RESIDENCE CERTIFICATION

In accordance with Art. 601g, as passed by the 1985 Texas Legislature, the following will apply. The pertinent portion of the Act has been extracted and is as follows:

Section 1. (a)

(1) "Nonresident bidder" means a bidder whose principal place of business is not in this state, but excludes a contractor whose ultimate parent company or majority owner has its principal place of business in this state.

(2) "Texas resident bidder " means a bidder whose principal place of business is in this state, and includes a contractor whose ultimate parent company or majority owner has its principal place of business in this state.

Section 1. (b)

The state or governmental agency of the state may not award a contract for general construction, improvements, services, or public works projects or purchases of supplies, materials or equipment to a nonresident bidder unless the nonresident's bid is lower than the lowest bid submitted by a responsible Texas resident bidder by the same amount that a Texas resident bidder would be required to underbid a nonresident bidder to obtain a comparable contract in the state in which the nonresident's principal place of business is located.

I certify that _____
(Company Name) is a **resident Texas bidder** as defined in Art. 601g.

Signature: _____

Print Name: _____

I certify that _____
(Company Name) is a **nonresident bidder** as defined in Art. 601g. and our principal place of business is: _____

(City and State)

Signature: _____

Print Name: _____

Organization Name
State Law Verifications

I, _____ (Person's name), the undersigned representative of (Company or Business name) _____ (hereafter referred to as the "Company") being an adult over the age of eighteen (18) years of age, after being duly sworn by the undersigned notary, do hereby depose and verify under oath as follows:

- **IRAN, SUDAN AND FOREIGN TERRORIST ORGANIZATIONS:** By submission of a response to City of Brownsville Public Utilities Board ("BPUB") Request for Qualifications B035-26 (the "RFB"), the responding Company represents that, to the extent this proposal submission or any contracts executed in response to this proposal constitutes a governmental contract within the meaning of Section 2252.151 of the Texas Government Code, as amended, solely for purposes of compliance with Section 2252.152 of the Texas Government Code, and except to the extent otherwise required by applicable federal law, neither the responding Company, nor any wholly owned subsidiary, majority-owned subsidiary, parent company or affiliate of the Company is a company listed by the Texas Comptroller of Public Accounts under Sections 806.051, 807.051, or 2252.153 of the Texas Government Code.
- **ANTI-BOYCOTT ISRAEL VERIFICATION:** By submission of a response to the BPUB RFQ, the responding Company represents that, to the extent this proposal submission, or any contracts executed in response to this proposal, constitutes a contract for goods or services within the meaning of Section 2271.002 of the Texas Government Code, as amended, solely for purposes of compliance with Chapter 2271 of the Texas Government Code, and subject to applicable federal law, including without limitation, 50 U.S.C. Section 4607, the responding Company, as well as any wholly owned subsidiary, majority-owned subsidiary, parent company or affiliate of the Company, (1) does not boycott Israel and (2) will not boycott Israel through the term of any such contract. The term "boycott Israel" as used in this paragraph has the meaning assigned to such term in Section 808.001 of the Texas Government Code, as amended.
- **VERIFICATION REGARDING NO DISCRIMINATION AGAINST FIREARMS:** By submission of a response to the BPUB RFQ, the responding Company represents that, to the extent this proposal submission, or any contracts executed in response to this proposal, constitutes a contract for goods or services for which a written verification is required under Section 2274.002, Texas Government Code (as added by Senate Bill 19, 87th Texas Legislature, Regular Session), as amended, the responding Company hereby verifies that it, as well as any wholly owned subsidiary, majority-owned subsidiary, parent company or affiliate of the Firm, (1) does not have a practice, policy, guidance, or directive that discriminates against a firearm entity or firearm trade association; and (2) will not discriminate during the term of any such contract against a firearm entity or firearm trade association. The foregoing verification is made solely to comply with Section 2274.002, Texas Government Code (as added by Senate Bill 19, 87th Texas Legislature, Regular Session), as amended, to the extent such section does not contravene

BROWNSVILLE PUBLIC UTILITIES BOARD

RESIDENCE CERTIFICATION

In accordance with Art. 601g, as passed by the 1985 Texas Legislature, the following will apply. The pertinent portion of the Act has been extracted and is as follows:

Section 1. (a)

(1) "Nonresident bidder" means a bidder whose principal place of business is not in this state, but excludes a contractor whose ultimate parent company or majority owner has its principal place of business in this state.

(2) "Texas resident bidder " means a bidder whose principal place of business is in this state, and includes a contractor whose ultimate parent company or majority owner has its principal place of business in this state.

Section 1. (b)

The state or governmental agency of the state may not award a contract for general construction, improvements, services, or public works projects or purchases of supplies, materials or equipment to a nonresident bidder unless the nonresident's bid is lower than the lowest bid submitted by a responsible Texas resident bidder by the same amount that a Texas resident bidder would be required to underbid a nonresident bidder to obtain a comparable contract in the state in which the nonresident's principal place of business is located.

I certify that _____(Company Name) is a **resident Texas bidder** as defined in Art. 601g.

Signature: _____

Print Name: _____

I certify that _____(Company Name) is a **nonresident bidder** as defined in Art. 601g. and our principal place of business is:

(City and State)

Signature: _____

Print Name: _____

CONFIDENTIAL

Form **W-9**
(Rev. March 2024)
Department of the Treasury
Internal Revenue Service

Request for Taxpayer Identification Number and Certification

Go to www.irs.gov/FormW9 for instructions and the latest information.

Give form to the
requester. Do not
send to the IRS.

Before you begin. For guidance related to the purpose of Form W-9, see *Purpose of Form*, below.

Print or type. See Specific Instructions on page 3.	1 Name of entity/individual. An entry is required. (For a sole proprietor or disregarded entity, enter the owner's name on line 1, and enter the business/disregarded entity's name on line 2.)	
	2 Business name/disregarded entity name, if different from above.	
	3a Check the appropriate box for federal tax classification of the entity/individual whose name is entered on line 1. Check only one of the following seven boxes. <input type="checkbox"/> Individual/sole proprietor <input type="checkbox"/> C corporation <input type="checkbox"/> S corporation <input type="checkbox"/> Partnership <input type="checkbox"/> Trust/estate <input type="checkbox"/> LLC. Enter the tax classification (C = C corporation, S = S corporation, P = Partnership) _____ Note: Check the "LLC" box above and, in the entry space, enter the appropriate code (C, S, or P) for the tax classification of the LLC, unless it is a disregarded entity. A disregarded entity should instead check the appropriate box for the tax classification of its owner. <input type="checkbox"/> Other (see instructions) _____	4 Exemptions (codes apply only to certain entities, not individuals; see instructions on page 3): Exempt payee code (if any) _____ Exemption from Foreign Account Tax Compliance Act (FATCA) reporting code (if any) _____ <i>(Applies to accounts maintained outside the United States.)</i>
	3b If on line 3a you checked "Partnership" or "Trust/estate," or checked "LLC" and entered "P" as its tax classification, and you are providing this form to a partnership, trust, or estate in which you have an ownership interest, check this box if you have any foreign partners, owners, or beneficiaries. See instructions _____ <input type="checkbox"/>	
	5 Address (number, street, and apt. or suite no.). See instructions.	Requester's name and address (optional)
	6 City, state, and ZIP code	
	7 List account number(s) here (optional)	

Part I Taxpayer Identification Number (TIN)

Enter your TIN in the appropriate box. The TIN provided must match the name given on line 1 to avoid backup withholding. For individuals, this is generally your social security number (SSN). However, for a resident alien, sole proprietor, or disregarded entity, see the instructions for Part I, later. For other entities, it is your employer identification number (EIN). If you do not have a number, see *How to get a TIN*, later.

Social security number	
OR	
Employer identification number	

Note: If the account is in more than one name, see the instructions for line 1. See also *What Name and Number To Give the Requester* for guidelines on whose number to enter.

Part II Certification

Under penalties of perjury, I certify that:

- The number shown on this form is my correct taxpayer identification number (or I am waiting for a number to be issued to me); and
- I am not subject to backup withholding because (a) I am exempt from backup withholding, or (b) I have not been notified by the Internal Revenue Service (IRS) that I am subject to backup withholding as a result of a failure to report all interest or dividends, or (c) the IRS has notified me that I am no longer subject to backup withholding; and
- I am a U.S. citizen or other U.S. person (defined below); and
- The FATCA code(s) entered on this form (if any) indicating that I am exempt from FATCA reporting is correct.

Certification instructions. You must cross out item 2 above if you have been notified by the IRS that you are currently subject to backup withholding because you have failed to report all interest and dividends on your tax return. For real estate transactions, item 2 does not apply. For mortgage interest paid, acquisition or abandonment of secured property, cancellation of debt, contributions to an individual retirement arrangement (IRA), and, generally, payments other than interest and dividends, you are not required to sign the certification, but you must provide your correct TIN. See the instructions for Part II, later.

Sign Here	Signature of U.S. person	Date
------------------	--------------------------	------

General Instructions

Section references are to the Internal Revenue Code unless otherwise noted.

Future developments. For the latest information about developments related to Form W-9 and its instructions, such as legislation enacted after they were published, go to www.irs.gov/FormW9.

What's New

Line 3a has been modified to clarify how a disregarded entity completes this line. An LLC that is a disregarded entity should check the appropriate box for the tax classification of its owner. Otherwise, it should check the "LLC" box and enter its appropriate tax classification.

New line 3b has been added to this form. A flow-through entity is required to complete this line to indicate that it has direct or indirect foreign partners, owners, or beneficiaries when it provides the Form W-9 to another flow-through entity in which it has an ownership interest. This change is intended to provide a flow-through entity with information regarding the status of its indirect foreign partners, owners, or beneficiaries, so that it can satisfy any applicable reporting requirements. For example, a partnership that has any indirect foreign partners may be required to complete Schedules K-2 and K-3. See the Partnership Instructions for Schedules K-2 and K-3 (Form 1065).

Purpose of Form

An individual or entity (Form W-9 requester) who is required to file an information return with the IRS is giving you this form because they

CONFIDENTIAL

Form **W-8BEN-E**

(Rev. October 2021)
Department of the Treasury
Internal Revenue Service

Certificate of Status of Beneficial Owner for United States Tax Withholding and Reporting (Entities)

▶ For use by entities. Individuals must use Form W-8BEN. ▶ Section references are to the Internal Revenue Code.
▶ Go to www.irs.gov/FormW8BENE for instructions and the latest information.
▶ Give this form to the withholding agent or payer. Do not send to the IRS.

OMB No. 1545-1621

Do NOT use this form for:

- U.S. entity or U.S. citizen or resident W-9
- A foreign individual W-8BEN (Individual) or Form 8233
- A foreign individual or entity claiming that income is effectively connected with the conduct of trade or business within the United States (unless claiming treaty benefits) W-8ECI
- A foreign partnership, a foreign simple trust, or a foreign grantor trust (unless claiming treaty benefits) (see instructions for exceptions) W-8IMY
- A foreign government, international organization, foreign central bank of issue, foreign tax-exempt organization, foreign private foundation, or government of a U.S. possession claiming that income is effectively connected U.S. income or that is claiming the applicability of section(s) 115(2), 501(c), 892, 895, or 1443(b) (unless claiming treaty benefits) (see instructions for other exceptions) W-8ECI or W-8EXP
- Any person acting as an intermediary (including a qualified intermediary acting as a qualified derivatives dealer) W-8IMY

Instead use Form:

Part I Identification of Beneficial Owner

1 Name of organization that is the beneficial owner	2 Country of incorporation or organization
--	---

3 Name of disregarded entity receiving the payment (if applicable, see instructions)

4 Chapter 3 Status (entity type) (Must check one box only):

<input type="checkbox"/> Simple trust	<input type="checkbox"/> Tax-exempt organization	<input type="checkbox"/> Corporation	<input type="checkbox"/> Partnership
<input type="checkbox"/> Central Bank of Issue	<input type="checkbox"/> Private foundation	<input type="checkbox"/> Complex trust	<input type="checkbox"/> Foreign Government - Controlled Entity
<input type="checkbox"/> Grantor trust	<input type="checkbox"/> Disregarded entity	<input type="checkbox"/> Estate	<input type="checkbox"/> Foreign Government - Integral Part
		<input type="checkbox"/> International organization	

If you entered disregarded entity, partnership, simple trust, or grantor trust above, is the entity a hybrid making a treaty claim? If "Yes," complete Part III. Yes No

5 Chapter 4 Status (FATCA status) (See instructions for details and complete the certification below for the entity's applicable status.)

<input type="checkbox"/> Nonparticipating FFI (including an FFI related to a Reporting IGA FFI other than a deemed-compliant FFI, participating FFI, or exempt beneficial owner). <input type="checkbox"/> Participating FFI. <input type="checkbox"/> Reporting Model 1 FFI. <input type="checkbox"/> Reporting Model 2 FFI. <input type="checkbox"/> Registered deemed-compliant FFI (other than a reporting Model 1 FFI, sponsored FFI, or nonreporting IGA FFI covered in Part XII). See instructions. <input type="checkbox"/> Sponsored FFI. Complete Part IV. <input type="checkbox"/> Certified deemed-compliant nonregistering local bank. Complete Part V. <input type="checkbox"/> Certified deemed-compliant FFI with only low-value accounts. Complete Part VI. <input type="checkbox"/> Certified deemed-compliant sponsored, closely held investment vehicle. Complete Part VII. <input type="checkbox"/> Certified deemed-compliant limited life debt investment entity. Complete Part VIII. <input type="checkbox"/> Certain investment entities that do not maintain financial accounts. Complete Part IX. <input type="checkbox"/> Owner-documented FFI. Complete Part X. <input type="checkbox"/> Restricted distributor. Complete Part XI.	<input type="checkbox"/> Nonreporting IGA FFI. Complete Part XII. <input type="checkbox"/> Foreign government, government of a U.S. possession, or foreign central bank of issue. Complete Part XIII. <input type="checkbox"/> International organization. Complete Part XIV. <input type="checkbox"/> Exempt retirement plans. Complete Part XV. <input type="checkbox"/> Entity wholly owned by exempt beneficial owners. Complete Part XVI. <input type="checkbox"/> Territory financial institution. Complete Part XVII. <input type="checkbox"/> Excepted nonfinancial group entity. Complete Part XVIII. <input type="checkbox"/> Excepted nonfinancial start-up company. Complete Part XIX. <input type="checkbox"/> Excepted nonfinancial entity in liquidation or bankruptcy. Complete Part XX. <input type="checkbox"/> 501(c) organization. Complete Part XXI. <input type="checkbox"/> Nonprofit organization. Complete Part XXII. <input type="checkbox"/> Publicly traded NFFE or NFFE affiliate of a publicly traded corporation. Complete Part XXIII. <input type="checkbox"/> Excepted territory NFFE. Complete Part XXIV. <input type="checkbox"/> Active NFFE. Complete Part XXV. <input type="checkbox"/> Passive NFFE. Complete Part XXVI. <input type="checkbox"/> Excepted inter-affiliate FFI. Complete Part XXVII. <input type="checkbox"/> Direct reporting NFFE. <input type="checkbox"/> Sponsored direct reporting NFFE. Complete Part XXVIII. <input type="checkbox"/> Account that is not a financial account.
---	---

6 Permanent residence address (street, apt. or suite no., or rural route). **Do not use a P.O. box or in-care-of address** (other than a registered address).


City or town, state or province. Include postal code where appropriate.	Country
---	---------

7 Mailing address (if different from above)


City or town, state or province. Include postal code where appropriate.	Country
---	---------

See attached the latest approved drawings for transformer concrete pads **to be aware of dimensions needed:**

- UD-14 Typical Concrete Pad for Single Phase Padmounted Transformer
- UD-15 Typical Concrete Pad for 1500 kVA / 2400V for Three Phase Padmounted Transformer
- UD-16 Typical Concrete Pad for 45 to 500 kVA Three Phase Padmounted Transformer
- UD-17 Typical Concrete Pad for 750 to 2500 kVA Three Phase Padmounted Transformer

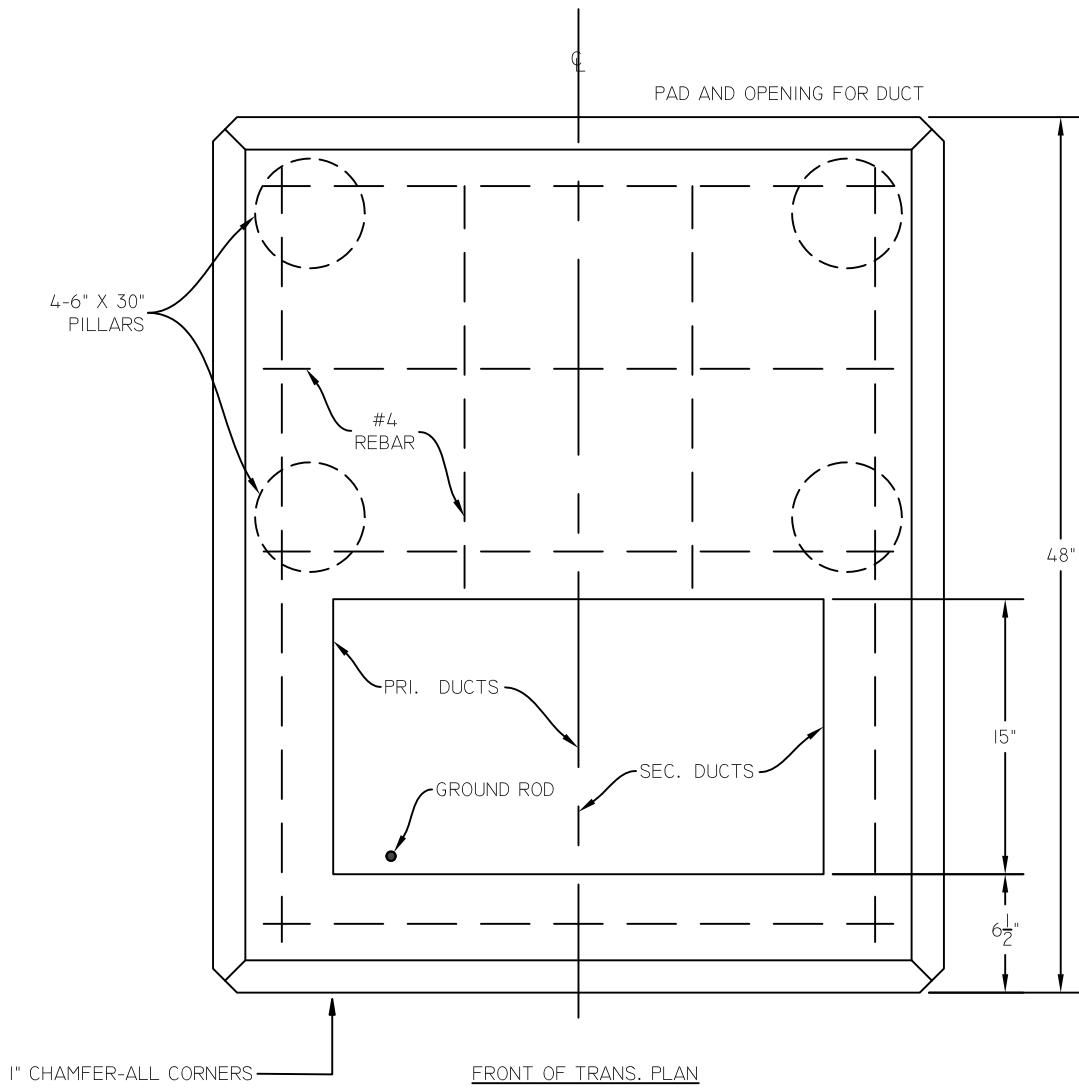

1" CHAMFER-ALL CORNERS FRONT OF TRANS. PLAN

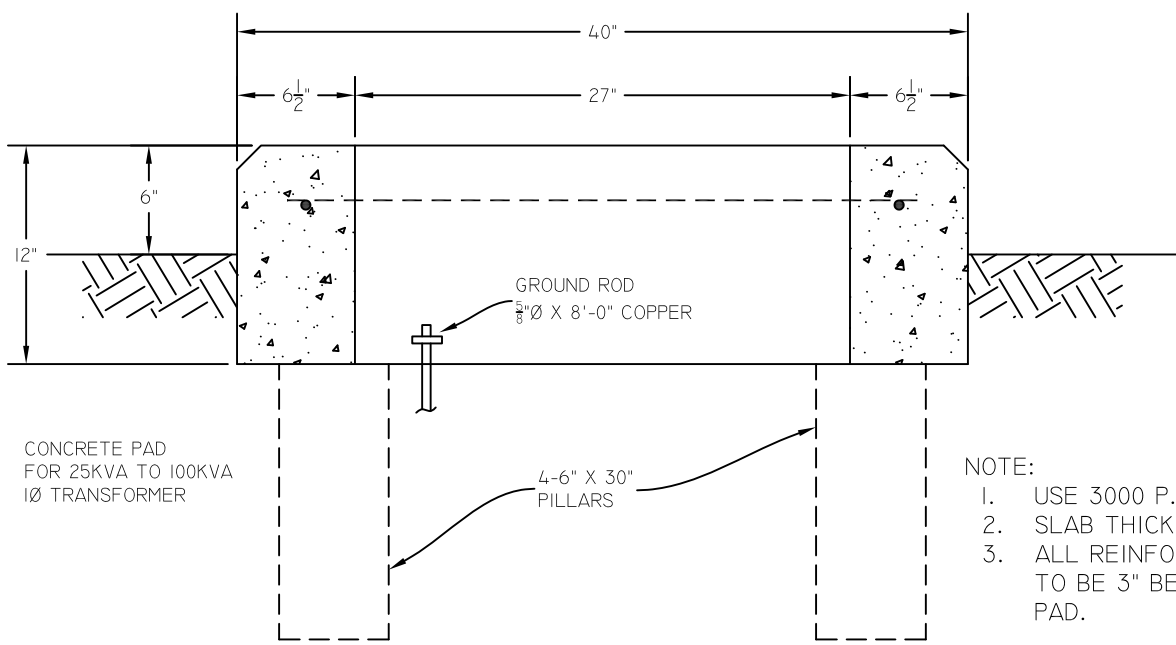

CONCRETE PAD FOR 25KVA TO 100KVA Ø TRANSFORMER


- NOTE:
1. USE 3000 P.S.I. CONCRETE.
 2. SLAB THICKNESS TO BE 12".
 3. ALL REINFORCING STEEL TO BE 3" BELOW TOP OF PAD.





TYPICAL STEEL REINFORCED
CONCRETE PAD FOR SINGLE-PHASE
PAD-MOUNTED TRANSFORMER

DEVELOPED BY:
APPROVED:
DRAWING
NUMBER

STANDARDS
COMMITTEE
SEP 2020
UD-14



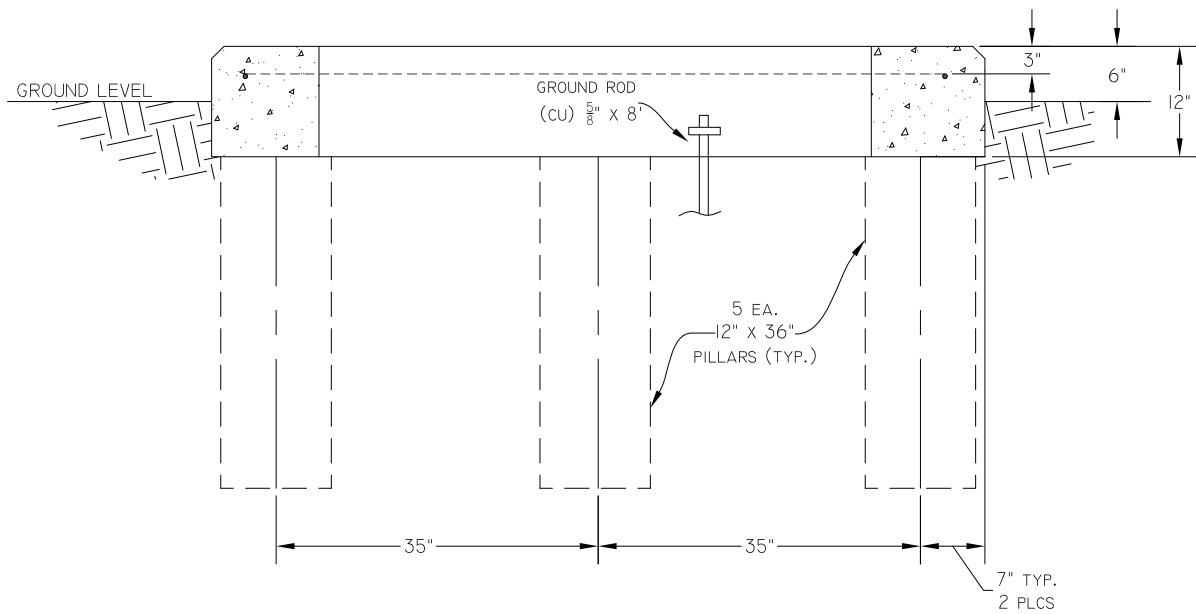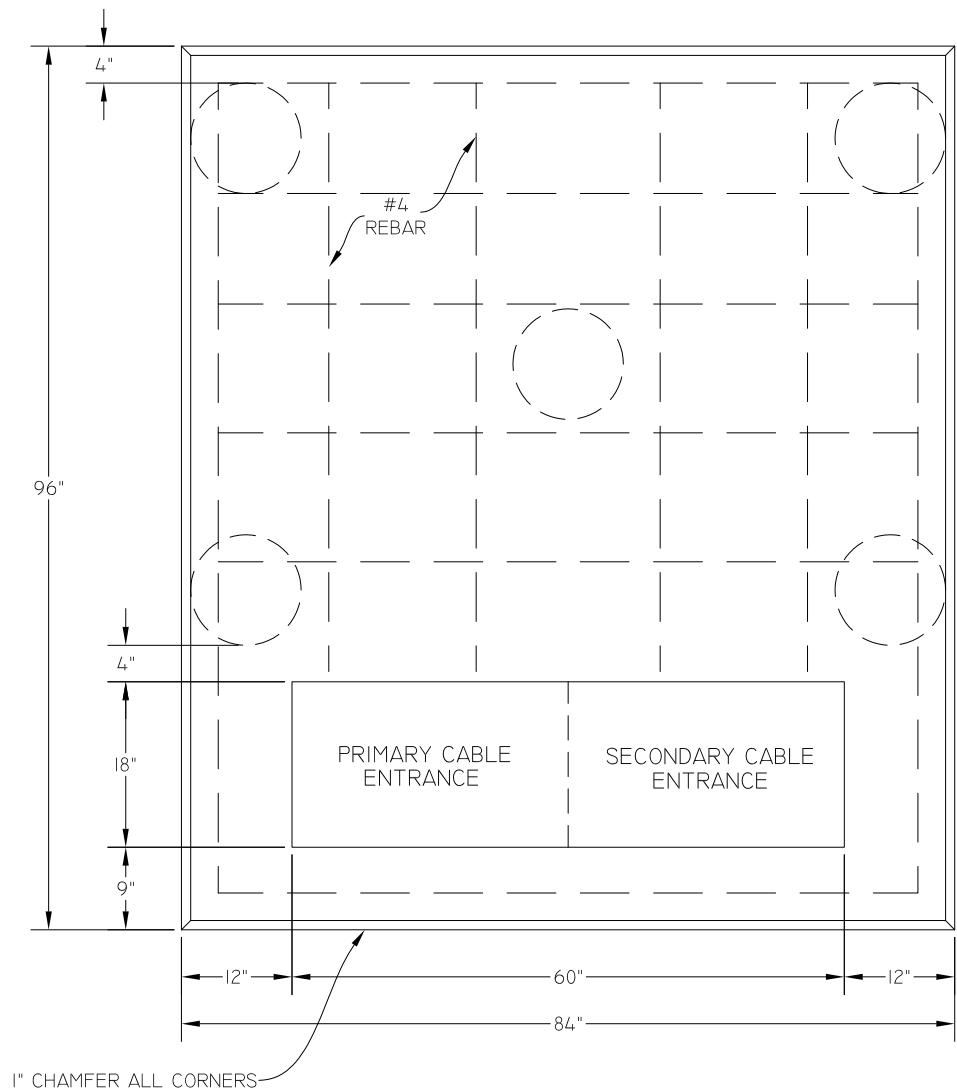

NOTE:

1. USE 3000 P.S.I. CONCRETE.
2. SLAB THICKNESS TO BE 12".
3. ALL REINFORCING STEEL TO BE 3" BELOW TOP OF PAD.



**TYPICAL CONCRETE PAD FOR
1500 KVA / 2400V 3 PHASE
PAD-MOUNTED TRANSFORMER**

DEVELOPED BY:


STANDARDS
COMMITTEE


APPROVED:

SEP 2020

DRAWING
NUMBER

UD-15



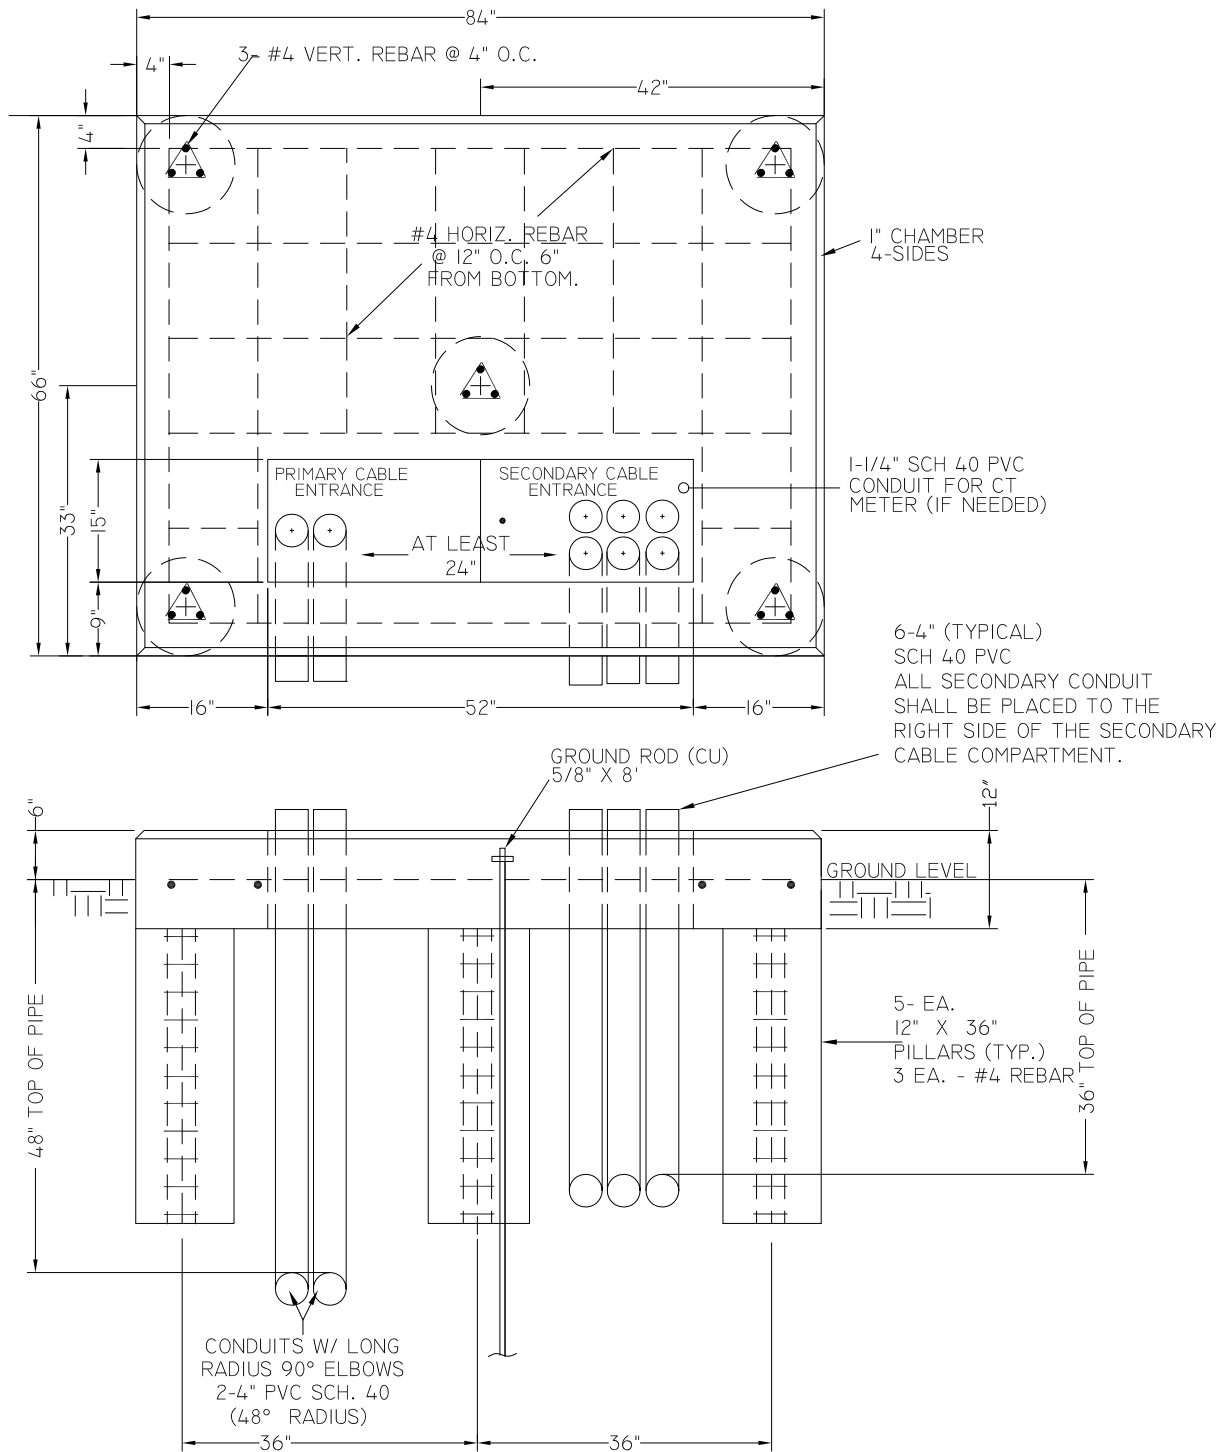


NOTES:



1. USE 3000 P.S.I. CONCRETE.
2. SLAB THICKNESS TO BE 12" MINIMUM.
3. ALL REINFORCING STEEL TO BE 6" BELOW TOP OF PAD.
4. 1 1/4" MIN PVC CONDUIT FOR CT'S WIRES @ SEC. CABLE ENTRANCE TO METER LOCATION.
5. COMPACT SOIL 95% BEFORE INSTALLING CONCRETE PAD.
6. ALL MATERIALS PROVIDED AND INSTALLED BY THE COSTUMER.
7. MUST MEET ALL REQUIREMENTS OF BPUB STANDARD DRAWING ENG-8.



**TYPICAL CONCRETE PAD FOR
45 TO 500 KVA 3 PHASE
PAD-MOUNTED TRANSFORMER**

DEVELOPED BY:	STANDARDS COMMITTEE
APPROVED:	SEP 2020
DRAWING NUMBER	UD-16



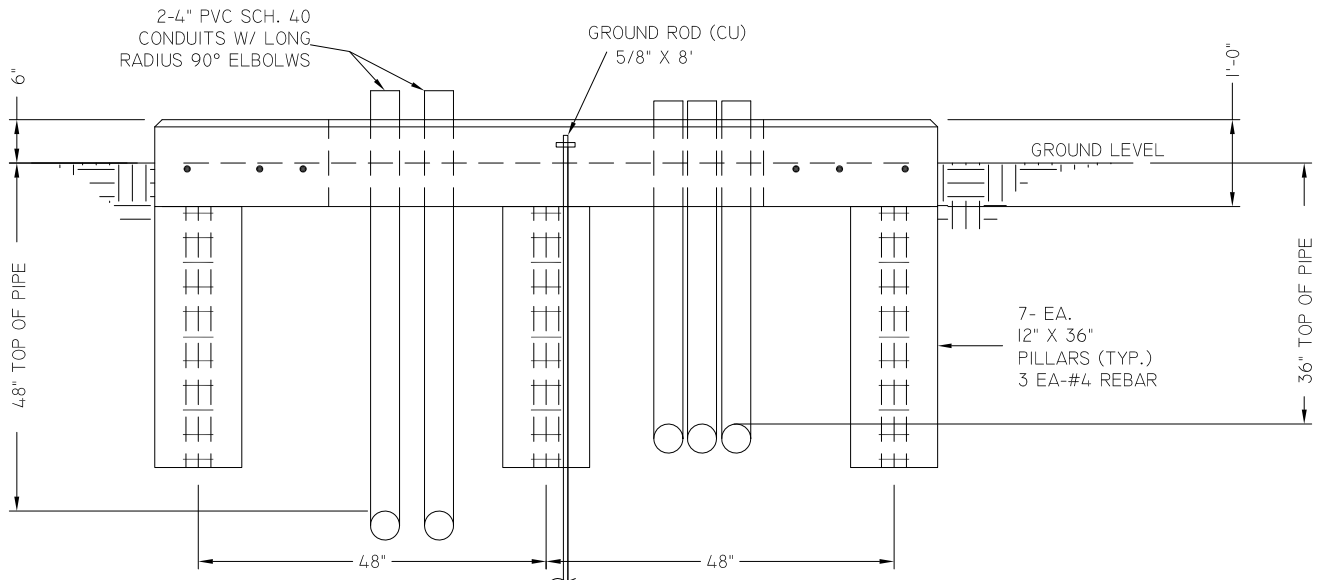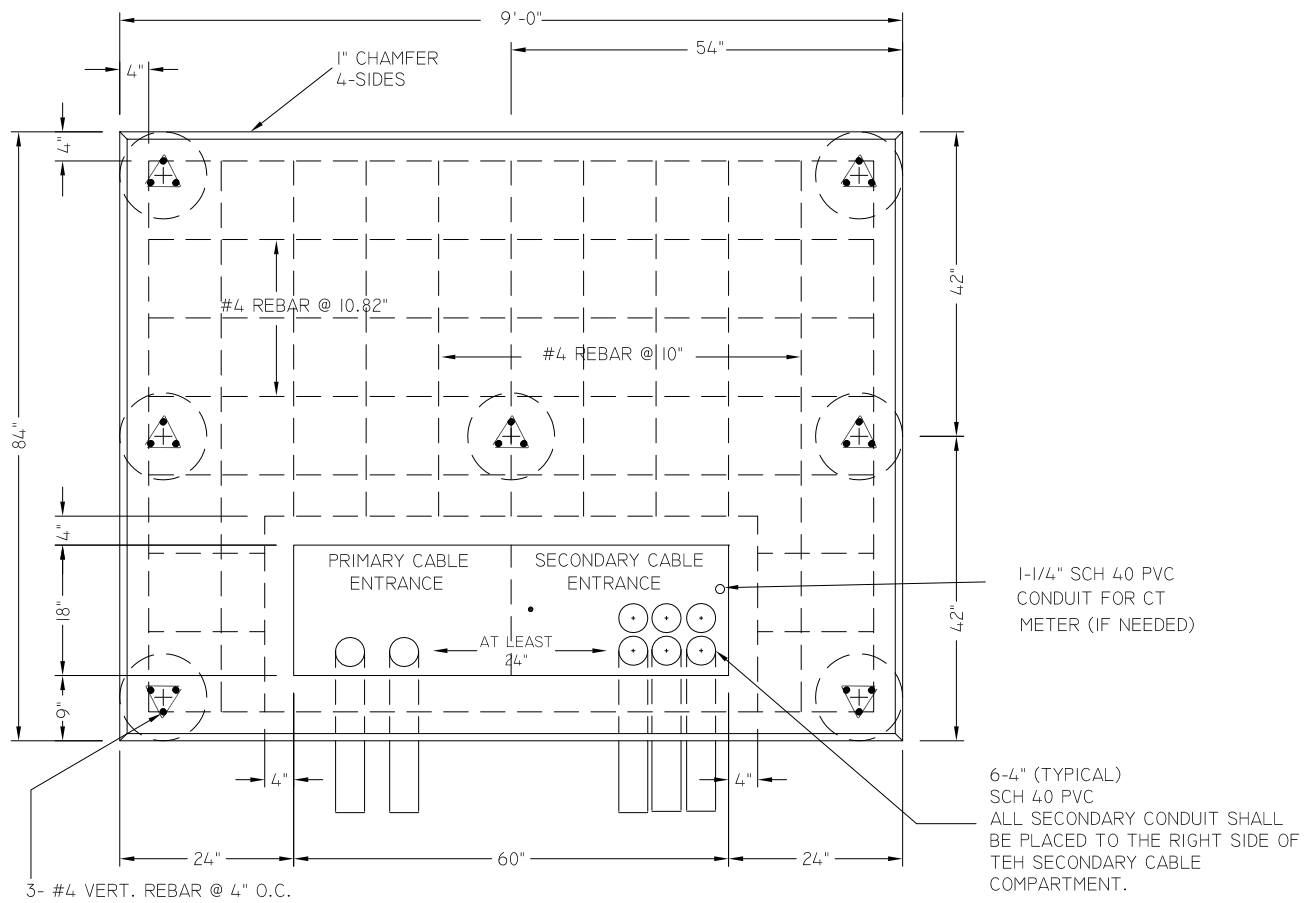

NOTES:

1. USE 3000 P.S.I. CONCRETE.
2. SLAB THICKNESS TO BE 12" MINIMUM.
3. ALL REINFORCING STEEL TO BE 6" BELOW TOP OF PAD.
4. 1 1/4" MIN PVC CONDUIT FOR CT'S WIRES @ SEC. CABLE ENTRANCE TO METER LOCATION.
5. COMPACT SOIL 95% BEFORE INSTALLING CONCRETE PAD.
6. ALL MATERIALS PROVIDED AND INSTALLED BY THE COSTUMER.
7. MUST MEET ALL REQUIREMENTS OF BPUB STANDARD DRAWING ENG-8.



**TYPICAL CONCRETE PAD FOR
750 TO 2500 KVA 3 PHASE
PAD-MOUNTED TRANSFORMER**

DEVELOPED BY:	STANDARDS COMMITTEE
APPROVED:	SEP 2020
DRAWING NUMBER	UD-17

